

---

This is an electronic reprint of the original article.  
This reprint may differ from the original in pagination and typographic detail.

Lund, Peter; Mikkola, J.; Salpakari, J.; Lindgren, J.

## Review of energy system flexibility measures to enable high levels of variable renewable electricity

*Published in:*  
Renewable and Sustainable Energy Reviews

*DOI:*  
[10.1016/j.rser.2015.01.057](https://doi.org/10.1016/j.rser.2015.01.057)

Published: 01/05/2015

*Document Version*  
Peer-reviewed accepted author manuscript, also known as Final accepted manuscript or Post-print

*Please cite the original version:*  
Lund, P., Mikkola, J., Salpakari, J., & Lindgren, J. (2015). Review of energy system flexibility measures to enable high levels of variable renewable electricity. *Renewable and Sustainable Energy Reviews*, 45, 785-807.  
<https://doi.org/10.1016/j.rser.2015.01.057>

---

This material is protected by copyright and other intellectual property rights, and duplication or sale of all or part of any of the repository collections is not permitted, except that material may be duplicated by you for your research use or educational purposes in electronic or print form. You must obtain permission for any other use. Electronic or print copies may not be offered, whether for sale or otherwise to anyone who is not an authorised user.

1  
2  
3  
4 **Review of energy system flexibility measures to enable high levels of variable**  
5 **renewable electricity**  
6  
7

8 Peter D. Lund<sup>a,\*</sup>, Juuso Lindgren<sup>a</sup>, Jani Mikkola<sup>a</sup>, Jyri Salpakari<sup>a</sup>  
9 <sup>a</sup> Department of Applied Physics, School of Science, Aalto University  
10 P.O. Box 14100, 00076 AALTO, Espoo, Finland  
11 \* Corresponding author, tel. +35840 515 0144, email: peter.lund@aalto.fi  
12  
13  
14  
15

16 **Abstract**  
17

18 The paper reviews different approaches, technologies, and strategies to manage large-scale schemes of  
19 variable renewable electricity such as solar and wind power. We consider both supply and demand side  
20 measures. In addition to presenting energy system flexibility measures, their importance to renewable  
21 electricity is discussed. The flexibility measures available range from traditional ones such as grid  
22 extension or pumped hydro storage to more advanced strategies such as demand side management and  
23 demand side linked approaches, e.g. the use of electric vehicles for storing excess electricity, but also  
24 providing grid support services. Advanced batteries may offer new solutions in the future, though the high  
25 costs associated with batteries may restrict their use to smaller scale applications. Different “P2Y”-type of  
26 strategies, where P stands for surplus renewable power and Y for the energy form or energy service to  
27 which this excess is converted to, e.g. thermal energy, hydrogen, gas or mobility are receiving much  
28 attention as potential flexibility solutions, making use of the energy system as a whole. To “functionalize”  
29 or to assess the value of the various energy system flexibility measures, these need often be put into an  
30 electricity/energy market or utility service context. Summarizing, the outlook for managing large amounts  
31 of RE power in terms of options available seems to be promising.  
32  
33  
34  
35  
36

37 **Keywords:** energy system flexibility, DSM, energy storage, ancillary service, electricity market, smart  
38 grid  
39

40 **Abbreviations**  
41

42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57

AC	alternating current
APC	active power curtailment
AUP	average unit price
CAES	compressed air energy storage
CCGT	combined-cycle gas turbine
CHP	combined heat and power
CPP	critical peak pricing
DHW	domestic hot water
DLC	direct load control
DOD	depth of discharge
DSM	demand side management
E2T	electricity-to-thermal
EV	electric vehicle

1		
2		
3		
4	EWH	electric water heater
5	HVAC	heating, ventilating, and air conditioning
6	HVDC	high-voltage direct current
7	ICT	information and communications technology
8	MPC	model predictive control
9	P2G	power-to-gas
10	P2H	power-to-hydrogen
11	PEV	plug-in electric vehicle
12	PHES	pumped hydro energy storage
13	pp	percentage point
14	PV	photovoltaic
15	RE	renewable energy, renewable electricity
16	RTP	real-time pricing
17	SG	smart grid
18	SMES	superconducting magnetic energy storage
19	TOU	time-of-use pricing
20	TSO	transmission system operator
21	V2G	vehicle-to-grid
22	VRE	variable renewable energy
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		
65		

## 1 Introduction

Energy systems need flexibility to match with the energy demand which varies over time. This requirement is pronounced in electric energy systems in which demand and supply need to match at each time point. In a traditional power system, this requirement is handled through a portfolio of different kind of power plants, which together are able to provide the necessary flexibility in an aggregated way. Once variable renewable electricity is introduced in large amounts to the power system, new kind of flexibility measures are needed to balance the supply/demand mismatches, but issues may also arise in different parts of the energy system such as in the distribution and transmission networks [1,2].

Large-scale schemes of renewable electricity, noticeably wind and solar power, are under way in several countries. Denmark plans to cover 100% of country's energy demand with renewable energy (RE) [3], Germany has as a goal to meet 80% of the power demand through renewables by 2050 [4], and in several other countries increasing the RE share is under discussion or debated [5–7]. At the same time, the renewable electricity markets are growing fast, e.g. in the EU, wind and solar stood for more than half of all new power investments in 2013 [8]. On a longer term, by 2050, RE sources could stand for a major share of all global electricity production according to several studies and scenarios [9–12]. Compared to today's use of RE in power production, the variable RE power utilization (VRE) could increase an order of magnitude or even more by the middle of this century. The experiences from countries with a notable VRE share, such as Denmark, Ireland and Germany, clearly indicate challenges with the technical integration of VRE into the existing power system, but also problems with the market mechanisms associated. Therefore, improving the flexibility of the energy system in parallel with increasing the RE power share would be highly important.

1  
2  
3  
4 There is a range of different approaches for increasing energy system flexibility, ranging from supply to  
5 demand side measures. Sometimes more flexibility could be accomplished through simply strengthening  
6 the power grid, enabling e.g. better spatial smoothing [13]. Recently, energy storage technologies have  
7 received much attention, in particular distributed and end-use side storage [14–16]. Storage would be  
8 useful with RE power [17], but it is often perceived somewhat optimistically as a generic solution to  
9 increasing flexibility, underestimating the scale in energy [18]. Different types of systemic innovations,  
10 e.g. considering the energy system as a whole and integrating power and thermal (heating/cooling) energy  
11 systems together, could considerably improve the integration of large-scale RE schemes [19,20]. The  
12 concept Smart Grid involves a range of different energy technologies and ICT to better manage the power  
13 systems and increase their flexibility [21]. Many other options are available as well.  
14  
15  
16  
17

18 The purpose of this study is to present a broad review of available and future options to increase energy  
19 system flexibility measures to enable high levels of renewable energy. Several of these measures are  
20 applicable for any type of energy system or energy supply. We present solutions that are linked to the  
21 demand side, electricity network, power supply, and the electricity markets. The literature on individual  
22 measures or technologies for energy system flexibility is vast. Recently, a few reviews on the subject have  
23 been published [22–26], but with a more narrow scope, whereas here we strive for a broader coverage of  
24 the available options. In addition to presenting options for energy system flexibility, we also try to reflect  
25 these against large-scale RE utilization and integration whenever possible.  
26  
27  
28  
29

## 30 **2 Defining flexibility**

31  
32 To operate properly, the power system needs to be in balance, i.e. power supply and demand in the  
33 electric grid has to match at each point of time. The electric system is built in such a way that it has up to  
34 a certain point a capability to cope with uncertainty and variability in both demand and supply of power.  
35 For example on the supply side, the kind of flexibility is accomplished through power plants with  
36 different response time. Introducing variable power generation such as wind and solar power may  
37 increase the need of energy system flexibility, which could be accomplished through additional measures  
38 on the supply or/and demand side which is the subject of this paper. From the electricity system point of  
39 view, flexibility relates closely to grid frequency and voltage control, delivery uncertainty and variability  
40 and power ramping rates.  
41  
42  
43

44 The metrics for defining flexibility can be derived from these effects. Huber et al. (2014) [27] used three  
45 metrics to characterize flexibility requirements, namely ramp magnitude, ramp frequency and response  
46 time, in particular of the net load which results when the variable renewable generation has been  
47 subtracted from the gross load. Their analysis included both a temporal and a spatial (smoothing) aspect  
48 of energy system flexibility. Blarke (2012) [28] looked on flexibility in a broader context integrating the  
49 VRE into a whole energy system context with thermal energy demand in addition to power and allowing  
50 power conversion to heat. In this case flexibility or intermittency friendliness of a supply or demand side  
51 agent was defined as a correlation between the net power exchange between a power plant and the grid,  
52 and the net power requirement (a correlation of 1 means that the distributed power producer matches  
53 perfectly the net power demand, -1 means a complete mismatch). Denholm et al. (2011) [29] analyzed  
54  
55  
56  
57

1  
2  
3  
4 flexibility in terms of the power plant mix (plants for base, intermediate, and peak load) and concluded in  
5 their analysis for Texas (US) that reducing the share of rigid base-load power plants would increase the  
6 system flexibility to incorporate increasing shares of variable generation.  
7

8  
9 These examples show that the metrics for defining flexibility may be unambiguous to different definitions  
10 as it is necessary to address the different aspects of the energy system. In the following chapters, in which  
11 the different approaches for increasing energy system flexibility are presented, using a single indicator to  
12 measure their goodness may not therefore be applicable. We have used the best available description for  
13 each case.  
14  
15

## 16 17 **3 Demand side management (DSM)**

### 18 19 **3.1 Overview**

20  
21 Demand side management (DSM) constitutes of a broad set of means to affect the patterns and magnitude  
22 of end-use electricity consumption. It can be categorized to reducing (peak shaving, conservation) or  
23 increasing (valley filling, load growth) or rescheduling energy demand (load shifting), see Fig. 1 [30].  
24 Load shifting requires some kind of an intermediate storage [31] and a utilization rate of less than 100 %  
25 [32] as both an increase and a decrease of power demand need to be possible in this case. Examples of  
26 load shifting include heat stored in an electrically-heated building, the food supplies in a refrigerator  
27 acting as a cold storage, an intermediate storage of pulp in the paper industry [33], or dirty and clean  
28 clothes or dishes as storages allowing for running a washing machine at any time [31]. However, many  
29 loads can be energy limited as they cannot provide their primary end-use function if enough energy is not  
30 provided during a time interval [22,34].  
31  
32

33  
34  
35 Load shifting is beneficial compared to the other DSM categories, as it allows for demand flexibility  
36 without compromising the continuity of the process or quality of the final service offered. While  
37 functionality similar to load shifting can also be provided with energy storage, an interesting difference is  
38 that DSM can be 100% efficient, as no energy conversion to and from an intermediate storable form is  
39 required [35].  
40  
41

42  
43 DSM can provide flexibility required to balance electricity generation and load which is important for  
44 variable renewable energy generation [34,36,37], as almost any measure taken on the power generation  
45 side has an equivalent demand-side countermeasure [34]. DSM measures can provide balancing both in  
46 terms of energy and capacity (power), and response in various time scales. Significant variability and  
47 uncertainty in VRE generation occurs in the time scale of 1–12 h, in which most mass market DSM  
48 opportunities are found [38].  
49  
50

51  
52 In addition, DSM can provide various other benefits to electrical energy systems and markets with  
53 renewable energy, such as reducing price spikes and the average spot price [31], shifting market power  
54 from generators to consumers [37], replacing or postponing infrastructure expansion [37,39,40], reducing  
55 use of costly peak power [37] and reducing transmission and distribution losses [41]. DSM may also  
56 facilitate energy efficiency measures [42,43].  
57

1  
2  
3  
4 Even though the idea of DSM is not new [44,45] its implementation has been slow [46]. It has  
5 traditionally been used to cut peak power demand and has only recently been applied to balance variable  
6 renewable production [36,47]. Barriers for DSM include e.g. lack of ICT infrastructure and technology  
7 financing [39,46], providing timely energy and price information [39] and communicating benefits to key  
8 stakeholders [46], poor response if not automated [39], minor unit savings [39], key stakeholder  
9 involvement [39], lack of incentive to invest in industry-wide benefits obtainable with DSM [39,46], rate  
10 structure design [39], and regulatory processes and policies to promote DSM [39]. ICT is a key  
11 technology for DSM, and the inherent privacy and security risks have to be handled with strict data  
12 handling guidelines [48]. On a consumer level, ICT could enable DSM incentivization through in-game  
13 scoring and social competition [49].  
14  
15  
16  
17

18 DSM programs can be classified as price based, including real-time pricing (RTP), critical peak pricing  
19 (CPP), and time-of-use pricing (TOU), and incentive-based programs, including direct load control  
20 (DLC) and direct participation to energy markets [37,50]. Price-based and market participation are more  
21 suitable for slow “energy trading” DSM [37], while reliability provision via fast DSM may require DLC  
22 for fast, predictable and reliable enough response [34,37,51]. Among price-based programs, RTP has the  
23 greatest potential to address VRE integration at all time scales longer than 10 min [38]. DLC programs  
24 are capable of addressing the minute-scale VRE variability that is too fast for price-based programs [38].  
25 However, DLC programs have the risk of reducing the inherent diversity of loads [46], leading even to  
26 oscillatory load population behavior [52], and all non-price responsive DSM has the baseline  
27 measurement problem: the response of customers is compared to a baseline to determine payment for the  
28 customer, but the baseline is impossible to measure [34,53,54].  
29  
30  
31  
32

## 33 **3.2 Potential of DSM**

34 To understand the importance of DSM for renewable electricity systems, we present in the next some  
35 estimates for the DSM potential in Germany and Finland with detailed data. Similar studies have also  
36 been undertaken in Norway [55], Denmark [55], Ireland [42], California [56,57] and Switzerland [58],  
37 among others. The DSM potential is typically split by sector (households, industry, service) each having  
38 its specific characteristics.  
39  
40

41 The technical potential of DSM is determined by the availability of flexible power capacity in general,  
42 possible restrictions of the power control, the duration for which the control can be applied and the  
43 effective energy storage capacity available in case the load is shiftable. Positive (i.e. decreasing load) and  
44 negative (i.e. increasing load) power capacities are often different. The costs associated with DSM are  
45 split into investments, variable costs and fixed costs [33]. In addition to technical and economic issues,  
46 DSM is also linked to behavioral aspects and decision-making [39,59,60] that affect the realizable  
47 potential of DSM, e.g. when connected to RE schemes.  
48  
49  
50

### 51 **3.2.1 Households**

52 DSM in households or residential loads is an interesting case as VRE is often applied in this scale, e.g.  
53 solar photovoltaics in buildings. DSM may in this case be viewed as a single decentralized measure, or if  
54 households are pooled together, as an aggregated utility-scale measure. In addition to the loads considered  
55 below, thermal energy storage in residential heating systems has a major DSM potential [61,62], though  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

1  
2  
3  
4 the DSM capacity depends on the type of storage and coupling to the residential HVAC system, and is  
5 case-specific [61].  
6

7  
8 The DSM potential of residential loads in Germany [63,64] is presented in **Error! Reference source not**  
9 **found..** The capacity values depend on the ambient temperature and/or control duration; the maximum  
10 values are reported here.  
11

12 To provide relevant metrics for VRE integration, the capacity and cost values are relative. The positive  
13 capacity (decreasable power) is relative to the minimum and maximum total net load (total load – VRE)  
14 in Germany during 2010–2012 (16 GW and 75 GW) and the negative capacity (increasable power) is in  
15 relation to the maximum VRE power feed-in, 29 GW in 2010 [65]. The virtual storage capacity obtained  
16 by load shifting is given relative to the total pumped hydro storage, 40 GWh in 2010 [66]. The  
17 investment, variable and fixed costs are relative to those of a typical gas turbine for power balancing:  
18 \$520/kW, \$88/MWh and \$23/kWa [67]. That is, the positive and negative capacity percentages determine  
19 what part of total net load, conventionally covered by control power plants, and VRE infeed could be  
20 covered by DSM, respectively. Hence, they characterize the technical importance of the DSM sources for  
21 VRE integration. If a given cost percentage is less than 100%, then the DSM option is cheaper in that  
22 respect.  
23  
24  
25  
26

27 The DSM investment costs comprise the energy management system [32,51] and fixed costs the  
28 communication costs [51]. As to carbon emissions, the DSM measures do not cause any emissions during  
29 their operation, in contrast to gas turbines with a typical emission value of 450 g<sub>CO2</sub>/kWh [68].  
30  
31

32 From Table 1 we see that night storage heaters are highly cost-competitive and can also provide  
33 significant capacity both in terms of power and energy storage. Heat pumps are also cost-competitive with  
34 gas turbines in terms of investment cost, but the capacity potential is limited. Both the night storage heater  
35 and heat pump strategies require coupling the DSM measures with the heating system. However, DSM  
36 capacity of the storage heaters and heat pumps diminishes at high ambient temperature when heating  
37 demand is low [64]. Synergies in energy management systems and communication could reduce both  
38 investment and fixed costs when the end-uses are combined.  
39  
40

41 Compared to the German case, DSM measures in Finland in the residential sector also offer a  
42 considerable potential for system flexibility. The majority of the potential, 23–29% of the winter peak  
43 load (in 2006), is in electric heating [69,70]. Wet and cold appliances contribute an additional 2.6%  
44 [69,70]. The dramatically increasing trend in heat pump penetration [71] brings about DSM potential due  
45 to cooling in the hot season, useful for e.g. solar electricity integration. Altogether the above DSM  
46 potential would be highly useful for large RE schemes.  
47  
48  
49

50 Assessing the true potential for DSM in the residential sector also requires considering the behavior and  
51 decision making of consumers. Incentivizing investments and participation in DSM programs may require  
52 quite large gains from the measures as the share of electricity costs of a household's total income is quite  
53 low, for example in the USA in 2009, it was on average 2.8% of total income, and the savings from DSM  
54 (1996-2007) 2–30% of electricity costs [39]. Similar experiences have been reported in Finland where the  
55  
56  
57

1  
2  
3  
4 consumers may be willing to pay a risk premium contained in the fixed electricity price contract instead  
5 of aiming for the minor savings [60]: average economic benefits of price-responsive demand compared to  
6 constant consumption were 1–2.4% (2001–2002) [72]. If the consumer has to cover the costs of required  
7 metering and control equipment, e.g. as part of smart metering or smart grid arrangements, the payback  
8 time without subsidies may get too long and discourage such schemes [39].  
9

### 10 11 **3.2.2 Service sector**

12 The technical and economic potential of DSM in the service sector in Germany [32,64] is presented in  
13 Table 2 with the same type of information as Table 1.  
14

15  
16 The spread of the costs for DSM measures shown in Table 2 is large, but at the lower end of the costs,  
17 DSM could be highly motivated. Comparing to the capacity values in Table 1, the DSM potential in the  
18 service sector is much lower than in the household sector.  
19

### 20 21 **3.2.3 Industrial loads**

22 The industry sector presents 42% of all electricity consumed in the world [73] and in some countries such  
23 as in Finland it is around half of all electricity used [74], in Germany 44% [75]. As an electric load,  
24 industries often represent a constant base load, in particular energy-intensive industrial loads which are  
25 large and centralized, and readily manageable by aggregators, utilities or system operators [57]. Such  
26 loads are already being used as reserves in Germany [33] and Finland [59]. Large-scale industrial loads  
27 are also price-responsive to some extent [59,76].  
28

29  
30 The DSM potential of industrial loads in Germany and Finland is reviewed in the following. The same  
31 industrial processes are most suitable for DSM in both countries. In addition, significant DSM  
32 possibilities have been found in calcium carbide production and quarries in Austria [77], and in oil  
33 extraction from tar sands and shale in USA [78].  
34

35  
36 The single industrial load types can only serve small parts of the total flexibility requirements. Variable  
37 costs tend to be lower for processes that can engage in load shifting, as there is no lost load; moreover, as  
38 the variable costs are normalized with respect to energy, they are the higher the lower the process energy  
39 intensity [33]. Fixed costs are negligible, as the load data is already monitored in real time [33].  
40 Investment costs are also low, as the investigated industries already feature the necessary smart metering  
41 and data exchange equipment [33].  
42

43  
44 The investment costs are, with the exception of ventilation systems, minor compared to a gas turbine.  
45 This is contrasted by the variable costs, which are higher than those of a gas turbine with the exception of  
46 pulp refining. This suggests that industrial loads are economical as peak and reserve capacity [33] which  
47 is useful for VRE integration.  
48

49  
50 In the Finnish case, where energy-intensive industries have a major share of all electricity, the following  
51 estimates for the technical potential of industrial loads has been presented [59]: grinders in pulp and  
52 paper industry 6% of the total peak load in Finland; electrolyses, electric arc furnaces and rolling mills in  
53 metal industry 2%; electrolyses, extruders and compressors in chemical industry 1%; and mills in cement,  
54  
55  
56



1  
2  
3  
4 lime and gypsum production 0.04%. Some of the above flexibility has already been contracted as  
5 disturbance reserve to the transmission system operator (TSO).  
6

7  
8 A major challenge in realizing the DSM potential in the industries comes from the demand of running  
9 industrial processes on a continuous basis [59]. Also, lack of storage capacity may hamper the shiftability  
10 of loads [33], or if the production line is run according to the customer's plans [60]. In practice, as  
11 industrial processes are integrated across different industry sectors and businesses, co-operation between  
12 the different stakeholders will often be necessary to implement DSM.  
13

14  
15 The fact that many industrial customers either buy electricity directly from suppliers with long term fixed  
16 price contracts or they have financially hedged their electricity market price risk decreases both their price  
17 response and their interest towards DSM [60], analogously to the situation of residential consumers.  
18 Large industrial customers may also perceive participation in the electricity market as not part of their  
19 business, even though, as of 2007, their interest in the involved profit opportunities had steadily increased  
20 in the Nordic region [79].  
21  
22

### 23 **3.3 Examples of DSM with renewable energy**

24  
25 The potential of DSM reviewed in the previous chapter is an estimate of the large-scale available  
26 potential, and is subject to limitations due to controllability of loads and behavior and decision-making of  
27 consumers. The effects of these limitations and the resulting actual applicable potential of DSM have  
28 been studied with field tests, DSM programs and modeling. DSM has been implemented quite extensively  
29 in the past, in particular as part of energy efficiency or peak shaving measures, but so far less in  
30 connection with VRE power schemes. In the next, we first present some conclusions from DSM field  
31 tests, programs and modeling studies which could be relevant to VRE and then shortly describe specific  
32 cases with DSM and VRE combined.  
33  
34

35  
36 On a macro-level, existing DSM programs in the USA both at wholesale and retail level represent a 38  
37 GW (5% of peak load [80]) potential for reducing peak load [81], approximately 90% of this potential  
38 provided by incentive-based programs. A time-of-use (TOU) pricing experiment in Pennsylvania gave a  
39 14% reduction in demand with 100% price increase [50]. A peak load reduction of 42% was  
40 accomplished during critical peak periods in a critical peak pricing (CPP) experiment in Florida with  
41 TOU rates during normal periods, and automatic load response to price signal [50]. Another incentive-  
42 based DSM program with 14,000 customers run by NYISO has lowered the peak consumption by 50  
43 kW/customer [50]. In a survey on utility experience with real time pricing (RTP) programs in the USA  
44 12-33% aggregate load reductions across a wide price range were reported [50]. Peak load reductions of  
45 16-34% have been reported in a survey of time-varying programs [82].  
46  
47  
48  
49

50 A dynamic pricing experiment in Finland on residential consumers showed that the consumption was  
51 reduced 13-16% during the peak hours with a peak-to-normal price ratio of 4:1, and 25-28% with a ratio  
52 of 12:1 [83], the load being in most cases shifted to off-peak periods [84]. The price response varied very  
53 much among the consumers [84]. Danish and Swedish experiences from single-family houses showed  
54 that up to 6 kW of shiftable load per house could be reached with DSM, and in Norway 1 kW reduction in  
55 electrical water heater and 2.5 kW in electrical hot water space heating loads has been reported [85]. A  
56  
57

1  
2  
3  
4 recent Finnish experiment with 3,600 electrically heated houses gave a 2 kW/house load reduction from  
5 DSM at peak conditions [85]. DSM employing building thermal mass in building cooling can also be  
6 effective: reducing the peak load by 25% and cost savings up to 50% has been reported in field  
7 experiments in the USA [62]. These examples demonstrate ca 10-50% flexibility margins which would be  
8 highly useful for a large-scale RE scheme, but also highlight the importance of an integrated view on  
9 electric and thermal loads.  
10  
11

12 Besides results from real DSM programs and field tests, the potential of DSM without explicit connection  
13 to VRE schemes has been dealt with in several modeling studies [62,86–92] yielding same kind of results  
14 as described above.  
15  
16

17 Most of the literature on DSM and VRE combined concerns residential loads. Paatero and Lund (2006)  
18 [93] developed a model for generating hourly flexible household electricity load profiles for VRE  
19 integration studies. Their case studies showed 42% and 61% of load reduction by controlling all the  
20 domestic appliances in response to loss of VRE supply during evening peak demand and in early  
21 afternoon, respectively [93,94].  
22  
23

24 Cao et al. (2013) [95] showed that it is both technically and economically more effective to store excess  
25 energy from PV and wind turbines in a detached house as thermal energy in a DHW tank than using  
26 batteries. The mismatch between load and VRE production was reduced by 13–23% through such a  
27 thermal storage DSM scheme.  
28  
29

30 Finn et al. (2011,2013) [35,96] studied optimal residential load shifting in connection with wind power.  
31 Optimal control for a residential water heater resulted in 4–33% cost savings and increased wind power  
32 demand by 5–26%. In case of a dishwasher, optimal control could increase wind power use by 34%.  
33  
34

35 Callaway (2009) [52] showed that populations of thermostatically controlled loads can be managed  
36 collectively to serve as virtual power plants that follow VRE feed-in variability. Zong et al. (2012) [97]  
37 developed a model predictive controller (MPC), based on dynamic price and weather forecast to realize  
38 load shifting and maximize PV consumption in an intelligent building.  
39  
40

41 At a single household level, DSM with VRE has, in addition to the aforementioned results, resulted in  
42 27–141% energy cost savings and 35% capacity cost savings with PV (over 100% savings achieved by  
43 PV production export), controllable loads and energy storage [98], 20% energy cost savings and 100%  
44 peak energy reduction with job scheduling and energy storage [99], 10% cost savings and 11 pp increase  
45 in wind production and heat pump load correlation [100], a few percent increase in PV self-consumption  
46 increase with only appliance scheduling and no use of electric heating [101], 6 pp increase in yearly PV  
47 self-consumption and 38 pp decrease in mean daily forecast error with deferrable loads and battery [102],  
48 5% decrease in diesel generator use in a wind-diesel-battery hybrid energy system with controllable loads  
49 [103], 8–22% energy cost savings with wind energy, load scheduling and a battery bank [104], 20.7%  
50 daily energy cost savings with PV, wind, appliance scheduling and batteries [105], and nearly 10% daily  
51 energy cost savings with wind, PV, controllable loads and an electric vehicle [106].  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

1  
2  
3  
4 In residential microgrids, the following results have been reached with DSM and VRE: 45% energy  
5 savings and 49% reduction in purchased energy with thermal storage, heat pumps and batteries in a single  
6 building, 6-flat microgrid with PV [107], 7% daily operation cost savings with batteries and heat pumps  
7 in a 6-house microgrid with PV in each house [108], 18.7% cost savings and 45% peak load reduction  
8 with task scheduling, thermal storage and batteries in a 30-home microgrid with CHP, wind and a gas  
9 boiler [109], 18% cost reduction with controllable loads and energy storage in a microgrid with wind, PV  
10 and a microturbine [110], 38% power generation cost reduction with wind and a fast conventional  
11 generator in an isolated microgrid with controllable loads, with further cost reduction of 21% by  
12 improving wind prediction accuracy [111], 56% decrease in electricity cost with load shifting and 79%  
13 decrease with load shifting and batteries with PV and biomass in 100-household self-sufficient village  
14 [112] and significant reduction in conventional energy storage size to smooth power fluctuation in main  
15 grid connection in a microgrid with 1000 heat pumps, wind and PV [113].  
16  
17  
18  
19

20 Concerning VRE and industrial load DSM, Finn and Fitzpatrick (2014) [114] have shown a clear  
21 correlation between a lower average unit electricity price (AUP) and increased use of wind power by two  
22 industrial consumers. Shifting demand to a low price regime was shown to provide substantial benefits,  
23 while little increase in wind power consumption was obtained by only shedding load during peak prices.  
24 A 10% reduction in the AUP typically resulted in a 5.8% increase of wind power use. VRE and service  
25 sector DSM has been studied in the case of balancing biomass gasification generator variability with a  
26 university fitness center, which brought savings of 33% and 44% compared to natural gas or diesel,  
27 respectively, along with decreased losses in grid and carbon emissions [115].  
28  
29  
30

31 The effect of DSM with VRE on distribution grids and larger systems has been studied broadly, with the  
32 following results: 20–24% reduction in generator startup cost [116], possibility to postpone generation  
33 capacity installation by 1–4 years in an island power system [117], 17% increase in wind power value and  
34 13% decrease in conventional plant running costs [118], 15% of VRE capacity as shiftable load required  
35 in a distribution grid to keep voltage fluctuations below 5% [119], 58% less capacity required to stabilize  
36 grid frequency with DSM compared to generators [120], ability to balance wind overproduction up to 1.5  
37 MW with a load and generator portfolio [121], peak-hour congestion reduction in EU transmission system  
38 with 17% VRE [122], 13% peak load reduction in the Portuguese power system with efficiency measures,  
39 17% by additional peak load control [123], 10% increase in wind share of optimal generation mix in  
40 Denmark [124], reduced correlation between electricity price and net load [125], 1.08 pp reduction in  
41 distribution losses in a distribution system [126], 2–3% decrease in energy cost and 2 pp decrease in  
42 transformer overloading in Western Danish power system with 126% wind capacity of maximum load  
43 [127], frequency stabilization in an islanded distribution system [128], 30% daily cost savings in an island  
44 power system during high wind production and low demand [129] and effective voltage stabilization in a  
45 distribution line with wind production [130]. Diversity of loads is required to prevent controlled loads  
46 becoming unresponsive in case of high/low wind generation for an extended time period [131].  
47  
48  
49  
50  
51  
52

53 Integrating heat pumps to buildings in the German electricity market with high RE penetration of 36–47%  
54 can bring about system cost savings of \$33 to \$52 per heat pump per year, along with CO<sub>2</sub> emissions  
55 reductions [132]. However, the change in building heat profile may lead to efficiency loss and increase  
56  
57

1  
2  
3  
4 electricity demand. Industrial DSM in the German electricity market with major RE share from 2007 to  
5 2020 can provide cumulative system cost savings of \$625 million, with avoided investment costs of \$442  
6 million, equivalent to two typical gas turbine plants [33]. The total DSM potential (incl. residential,  
7 service, and industrial sectors), together with improved wind power prediction, would result in additional  
8 balancing costs of less than \$2.6/MWh for 48 GW wind power in Germany in 2020 [133].  
9

10  
11 One of the most notable on-going projects of combining DSM and VRE is the EcoGrid EU in the island  
12 of Bornholm in Denmark [134]. More than 50% of the energy consumption will be produced by wind  
13 power and other VRE sources, and more than 10% of the local households and companies will engage in  
14 DSM [135].  
15

16  
17 To conclude, studies of DSM in connection with VRE schemes show on average around 20% cost  
18 reduction and 10–20% increase in VRE consumption due to DSM, in some cases combined with energy  
19 storage. The feasibility and benefits of effective frequency and voltage stabilization by DSM have also  
20 been shown. Good results achieved with electric heating schemes reflect again the potential of integrating  
21 electric and thermal loads.  
22  
23

## 24 25 26 **4 Grid ancillary services**

27 With increasing variable renewable power production, system stability issues will become more likely  
28 [22] which can be mitigated through grid ancillary services. These services are generic in nature, i.e. not  
29 necessarily bound to RE power use.  
30  
31

32 Grid ancillary services involve different time scales and requirements with regard to power and energy  
33 capacity. For example, a *power quality* service has to provide rapid response, but only for a short  
34 duration, so it is a power-intensive service. On the other hand, *load leveling*, is an energy-intensive  
35 service that provides long duration, but can respond more slowly. Because of the varying nature of the  
36 required services, optimal grid-integration of RE will most likely involve several different ancillary  
37 services.  
38  
39

40  
41 The grid ancillary services are presented more in detail in the following by dividing these into four  
42 categories based on their time response (see Table 4).  
43  
44

### 45 46 **4.1 Very short duration: milliseconds to 5 minutes**

#### 47 **4.1.1 Power quality and regulation**

48 *Power quality and regulation* is a power-intensive ancillary service that is characterized by a rapid and  
49 frequent response and very short duration. It is used to balance fluctuations in network frequency and  
50 voltage that arise from variations in wind and solar generators' output, along with their distributed nature  
51 [138]. A too sharp deviation can damage equipment, lead to tripping of power generating units, or even to  
52 a system collapse [139,140].  
53  
54

##### 55 **4.1.1.1 Energy storage for power quality and regulation**

1  
2  
3  
4 Energy storage can be used to mitigate these effects [141]. The storage systems are best suited for this  
5 service due to a rapid response time and high power ramping rate, as the fluctuations require action within  
6 seconds to minutes, and a high cycling capability, because continuous operation is required. A large  
7 storage capacity is here unnecessary as over 80% of the power line disturbances last for less than a second  
8 [142]. Therefore, batteries and especially supercapacitors, flywheels and superconducting magnets are  
9 among the best storage options for improving system stability [140,143–145].  
10

11  
12 Nevertheless, flywheels seem to be the most economical option. According to Breeze (2005), flywheels  
13 are one of the best and cheapest ways of maintaining power quality, having a capital cost of \$2,000/kW  
14 [146]. Makarov et al. (2008) concluded that flywheels and also PHES are economical storage  
15 technologies for reducing regulation requirements [147].  
16  
17

18  
19 Wind power plants may be able to provide power quality and regulation service with a form of inertial  
20 response based on the active control of their power electronics [138]. Even though this mechanism has its  
21 limitations, it may lower the value of an energy storage used solely for this purpose [22]. This view is  
22 shared by a NERC report which claims that storage may not be a good replacement for the traditional  
23 stability services (system inertial response, automatic equipment and control systems), unless it also  
24 provides other grid services [22,78].  
25  
26

#### 27 4.1.1.2 DSM for power quality and regulation

28 Shiftable loads are excellent candidates for providing balancing support, as the mean of the forecast errors  
29 of VRE is close to zero [34]. Loads can be used for frequency stabilization in a decentralized fashion with  
30 frequency-responsive loads, analogously to frequency-responsive generators, or with centralized control,  
31 which facilitates the restoration of system frequency to its nominal value [34]. Large motor loads provide  
32 natural inertial response analogously to rotating generators [78].  
33  
34

35  
36 Short et al. (2007) [120] studied decentralized frequency stabilization with a population of frequency-  
37 responsive domestic refrigerators. Their simulation showed that such an aggregation of loads can  
38 significantly improve frequency stability, both for a sudden demand increase or generation decrease and  
39 with fluctuating wind power.  
40

41  
42 Callaway (2009) [52] showed that thermostatically controlled loads can be managed centrally to follow  
43 wind power variability in 1-minute intervals. Kondoh et al. (2011) [148] analyzed direct control of  
44 electric water heaters (EWHs) to following regulation signals and estimated that 33,000 EWHs  
45 corresponded to 2 MW regulation over a 24 h period.  
46  
47

## 48 **4.2 Short duration: 5 minutes to 1 hour**

### 49 **4.2.1 Spinning, non-spinning and contingency reserves**

50 *Spinning reserve* refers to online power generation capacity synchronized to the grid having a short  
51 response time for ramping up but enabling several hours of use. They are generally used in contingency  
52 situations such as major generation and transmission failures [136]. Spinning reserves are restored to their  
53 pre-contingency status using replacement production reserves that should be online 30–60 minutes after  
54 the failure [136]. *Non-spinning reserve* is similar to spinning reserve, but without immediate response  
55 requirement. However, these reserves still need to fully respond within 10 minutes [78].  
56  
57

1  
2  
3  
4 Performing a spinning reserve service requires both a rapid response time and a large capacity for storing  
5 energy. According to Rabiee et al. (2013), suitable technologies are batteries and flow batteries,  
6 hydrogen, CAES and PHES [144]. Flywheels and SMES are also listed, but according to NERC (2010),  
7 they may not be able to provide sufficient long response [78].  
8  
9

10 As loads can shed very quickly, DSM is well-suited for reserve provision. Shiftable loads are in particular  
11 very suitable as the duration of the reserve provision is often short enough so that the load process is not  
12 disrupted [34]. Moreover, reserves are infrequently required [78]. Large industrial loads are already used  
13 as disturbance reserves in Germany [33], in the Nordic electricity market [59], and in several other  
14 markets [22,34]. In the Nordic and Texas markets, almost half of the contingency reserves comes from  
15 different loads [22]. The control of these large industrial loads, however, is in many cases quite simple,  
16 either manual [34,149] or through underfrequency relays [34]. Third party aggregators with more  
17 advanced control concepts are entering reserve markets, however [34].  
18  
19  
20

21 O'Dwyer et al. (2012) found significant potential in DLC of residential loads for reserve provision: 42%  
22 of the maximum reserve requirement in Ireland and North Ireland [42].  
23  
24

25 The addition of a 1,600 MW nuclear power plant at Olkiluoto in Finland, in combination with increasing  
26 wind capacity in the Nordic market, will increase the need for reserves in both Finland and the whole  
27 Nordic electricity market [79]. Loads are seen as economically competitive compared to e.g. gas turbines  
28 to provide these ancillary services [79].  
29  
30

#### 31 **4.2.2 Black-start**

32 *Black-start* describes the starting-up of a power plant after a major grid failure. The startup process  
33 requires some initial power input before the plant begins sustaining itself, and therefore an external source  
34 of power is needed. PHES can provide this initial power [150,151], while CAES has also been proposed  
35 [152].  
36  
37

38 The duration of the black-start ancillary service ranges from 15 minutes to 1 hour and the minimum  
39 annual number of charge-discharge cycles is around 10 to 20 [153]. It should be noted that some black-  
40 start generators may need to be black-started themselves [150].  
41  
42

### 43 **4.3 Intermediate duration: 1 hour to 3 days**

#### 44 **4.3.1 Load following**

45 *Load following* is a continuous grid service that is used to obtain a better match between power supply  
46 and demand. Energy storage can be used for this purpose, by storing power during a period of low  
47 demand and injecting it back into the grid during a period of low supply [141]. Batteries and flow  
48 batteries, hydrogen, CAES and PHES are well-suited for this application [78,144].  
49  
50

#### 51 **4.3.2 Load leveling**

52 *Load leveling* with energy storage refers to the evening-out of the typical mountain and valley-shape of  
53 electricity demand. As with load following, energy is absorbed during periods of low demand and  
54 injected back to the grid during high demand [141]. This allows baseload power generators to operate at  
55 higher efficiencies and also reduces the need for peaking power plants.  
56  
57

1  
2  
3  
4 Load leveling services are designed for time intervals from 1 to 10 hours. Because wind speeds tend to be  
5 higher at night-time, the benefits can be greater for wind-heavy systems [154]. This ancillary service can  
6 be provided by flow batteries, CAES, hydrogen and PHES [78,144], as all of them can handle large  
7 amounts of energy. Rabiee et al. also include batteries in this list [144]. Load curtailment during peak  
8 hours has been exercised by utilities for decades [34].  
9

#### 11 **4.3.3 Transmission curtailment prevention, transmission loss reduction**

12 *Transmission curtailment prevention* and *transmission loss reduction* are ancillary services that  
13 temporarily reduce the amount of current flowing in certain parts of the power grid, increasing the  
14 efficiency of transmission and preventing production curtailment due to power line limitations.  
15

16  
17 With much renewable energy production and no means of storing excess power, power production may  
18 need to be curtailed (cut off) to ensure system stability or due to limitations in transmission infrastructure.  
19 However, with energy storage, the power plants may continue harvesting energy even while being  
20 disconnected from the rest of the grid. Renewable power is injected into the energy storage system instead  
21 of the grid, and when the grid is ready for the dispatch, the storage is discharged. The duration  
22 requirement for such measures ranges from 5 to 12 hours.  
23

24  
25 An alternative is, of course, the increase of transmission capacity [13], but in some cases energy storage  
26 might be more economical, or even the only possible solution due to e.g. environmental and social  
27 concerns. Greater economic advantage may be gained in power plants that have access to different  
28 markets (e.g. spinning and non-spinning reserve markets) [22,155,156].  
29

30  
31 Storage also allows increasing the efficiency of transmission. Because transmission losses are  
32 proportional to the square of the current flow, the net resistive losses can be decreased by time-shifting  
33 some of the current from a peak period to an off-peak period, even when accounting for the losses due to  
34 storage. Also, during off-peak periods, temperature and therefore resistance are typically lower, yielding  
35 additional efficiency gains [41].  
36

37  
38 Suitable technologies for these applications are ones that are able to store large amounts of energy,  
39 particularly flow batteries, CAES, hydrogen and PHES [144].  
40

#### 42 **4.3.4 Unit commitment**

43 *Unit commitment* service refers to energy reserves that are used to manage errors and uncertainties in the  
44 predicted wind and solar output. For example, there might be an unforeseen shortage of wind for several  
45 days, requiring substitutive power to be supplied by discharging an energy reserve. The required duration  
46 ranges from minutes to several hours to days [156].  
47

48  
49 The ideal energy storage technology in this case is one that has a rapid response time, quick ramp-up and  
50 a large energy capacity. Thus, CAES, PHES and hydrogen are suitable for this application [78,144].  
51

52  
53 Competition has increased in DLC for unit commitment and economic dispatch by aggregators who bid  
54 load curtailment [34]. DSM may also be used to balance forecast uncertainty in energy procurement  
55 scheduling to local energy systems with VRE generation [157].  
56

## 4.4 Long duration: several months

### 4.4.1 Seasonal shifting

In *seasonal shifting*, energy is stored for up to several months. Seasonal shifting is most useful in systems with large seasonal variations in power consumption and generation. This service requires extremely large energy capacities, inexpensive storage medium and low self-discharge, making large PHES and gas storage the most suitable technologies [144,156,158].

To obtain some sense of scale, Converse (2012) estimated that shifting enough wind and solar power to supply the U.S. with electricity for a year would require a storage in the range of 10% and 20% of annual energy demand [18]. Tuohy et al. (2014) point out that this study did not consider production uncertainty [22].

Tuohy et al. (2014) [22] cast doubts on using DSM for seasonal shifting, as it is unlikely to have a long-term effect. While this holds for shifting consumption of most single loads, long-term DSM could be realized by leveraging different options for providing the end-use function. This is already visible in the form of a much higher long-term than short-term price elasticity of electricity [31]. E.g. heating DHW with gas during winter and with electricity during summer could even out the seasonal differences in electric heating, but the additional investment in multiple options might be uneconomical. Also, the production of products for which the demand follows a long-period cycle, e.g. storable holiday goods, could have long-term DSM potential.

## 5 Energy storage

Energy storage is used to time-shift the delivery of power. This allows temporary mismatches between supply and demand of electricity, which makes it a valuable system tool. Energy storage has recently gained renewed interest due to advances in storage technology, increase in fossil fuel prices and increased penetration of renewable energy [150]. In previous chapters, the usefulness of storage for ancillary services was already mentioned. In this chapter, we will present different storage technologies and a few additional energy system aspects.

Energy storage technologies are basically characterized through their energy storage and power capacities. A higher storage capacity allows the storage to respond to longer mismatches, while a higher power capacity allows responding to mismatches of higher magnitude.

There are a number of different technology options for energy storage, some of which are better suited for providing just one type of capacity (e.g. power), while some are more flexible and can provide both power and storage capacities to a some extent. However, no storage system can simultaneously provide a long lifetime, low cost, high density and high efficiency [145] meaning that a suitable storage technology needs to be selected on a case-by-case basis [159]. Here we consider pumped hydro power energy storage (PHES), compressed air (CAES), flywheels, batteries, hydrogen, superconducting magnets and supercapacitors.

### 5.1 Applications



1  
2  
3  
4 Energy storage has the potential to increase both the energy and economic efficiency of the power system.  
5 During a period of low energy demand, storing energy allows baseload power production to continue  
6 operating at high efficiency and during a period of high demand, allows use of stored energy instead of  
7 peaking power with high marginal costs [160].  
8  
9

10 All energy conversion processes are accompanied by conversion losses, so an energy storage facility is a  
11 net consumer of energy. However, taking advantage of the price difference of electricity, e.g. the  
12 difference between day-time and night-time electricity, allows energy storage facilities to generate  
13 revenue (*energy arbitrage*).  
14  
15

16 From the renewable integration standpoint, energy storage is an essential component [159], as wind and  
17 solar power are impractical for baseload power production. Furthermore, if additional fossil fuel-based  
18 generation is required to compensate for this variability, the effectiveness of renewables in reducing the  
19 total emissions diminishes [161–163]. With an energy storage, this variability can be greatly reduced  
20 [164]; indeed, energy storage may be the “ultimate solution” to the problem of variable generation [165].  
21  
22

23 However, in some cases, energy storage may actually *increase* the overall CO<sub>2</sub> emission levels. This can  
24 happen e.g. in the Dutch and the Irish power system, where energy storage allows storing power from  
25 cheap coal plants, substituting expensive gas during peak demand [160,166].  
26  
27

28 There are two main engineering approaches of integrating an energy storage system with variable  
29 renewable generation. The first is to locate the storage along the point of generation and tie its operation  
30 to this individual facility. This method, while considerably easier to model and study, also severely limits  
31 the potential utility. To maximize operational flexibility, the storage should not be limited to just one  
32 power plant if possible. Furthermore, integration with an individual plant prevents the storage from  
33 benefiting from the geographical smoothing effect, which may lead to uneconomical and inefficient  
34 operation. Therefore, as a general rule, the second approach of using the energy storage as a system-level  
35 flexibility resource, is more sensible both from an economical and efficiency point of view. The  
36 exceptions to this rule are the cases where significant benefits are gained from sharing a location, e.g. in a  
37 concentrating solar power plant it is sensible to locate the thermal storage near the site of generation.  
38 Another example is avoiding transmission upgrades to a remote wind resource [22,150,154,156,167].  
39  
40  
41  
42

43 The remainder of this section outlines the different storage technologies. For each technology, the main  
44 characteristics are described first and after this, renewable integration studies on this particular technology  
45 are covered.  
46  
47

## 48 **5.2 Storage technologies**

49 The most mature storage technologies are pumped hydro, compressed air and lead-acid batteries [141],  
50 but other well-known technologies, namely, flywheels, hydrogen, superconducting magnets and  
51 supercapacitors are also considered in this study. PHES is by far the largest energy storage technology  
52 available, accounting for 99% of the world’s total storage capacity [22],  
53  
54  
55

### 56 **5.2.1 Pumped hydro**

1  
2  
3  
4 In pumped hydro (pumped hydro energy storage, PHES), electricity is stored by pumping water to a  
5 higher gravitational potential, e.g. to a lake on the top of a hill. Electricity is later recovered by releasing  
6 the water to a lower reservoir through a hydro turbine. Over 300 PHES plants have been installed  
7 worldwide [151].  
8  
9

10 A PHES plant requires a location with adequate elevation difference and access to water flow and to an  
11 electricity transmission network. PHES does not require a natural elevation difference, as it is possible to  
12 dig an underground reservoir, while building the upper reservoir on the surface [168]. Some locations  
13 allow using the ocean as the lower reservoir, as in Okinawa Island, Japan [169].  
14  
15

16 PHES has two operating phases, pumping and generating phase and can operate on different time scales  
17 from less than a minute [170] to seasonal cycles [151]. The energy storage efficiency is around 65–85%  
18 [171–174].  
19  
20

21 PHES is a mature technology and it has been applied in large-scale with renewable power generation, e.g.  
22 in Portugal, where, 220 MW of reversible hydro power plants are used to support wind power generation  
23 [175]. Several simulations have demonstrated the potential of on wind-hydro schemes at a low cost [176–  
24 178].  
25  
26

27 Future development of PHES include e.g. artificial islands with underground reservoirs [179], ocean  
28 renewable energy storage [180], gravity power systems with two vertically parallel water reservoirs of  
29 which one is acting as a piston [181], and rail energy storage moving a heavy mass uphill on train tracks  
30 [182].  
31  
32

### 33 **5.2.2 Compressed air**

34 Compressed air energy storage (CAES) is the second largest form of energy storage in use. The working  
35 principle is based on compressing air to higher pressure, e.g. in an underground salt cavern or steel pipe,  
36 or even under the sea [183]. When extracting energy from CAES, the stored air is generally mixed with  
37 fuel, combusted and expanded through a turbine or series of turbines [78,140,144]. Basically, CAES is a  
38 gas turbine with the compressor and expander operating independently and at different times [184].  
39  
40

41 Two large CAES plants have been built: one in Huntorf, Germany (290 MW) and the other in Alabama  
42 (110 MW) [185,186]. Losses mainly occur during compression, but also if stored air is reheated.  
43 Elmegaard et al. (2011) reported a 25–45% efficiency for a practical CAES plant [187], while e.g.  
44 Greenblatt et al. (2006) estimated a typical CAES efficiency of 77–89% [188]. According to Elmegaard et  
45 al., the efficiency of an adiabatic CAES, in which the heat in the process is stored in a liquid or solid, is  
46 around 70–80% [187]. The environmental impacts from CAES are small [158]. Some authors have  
47 proposed a CAES plant to replace natural gas with hydrogen or biofuels to reduce emissions [189,190].  
48  
49  
50

51 The economics of CAES has been a problem in the past but it is expected to change with higher natural  
52 gas prices and increased renewable penetration [164]. Sundararagavan et al. (2012) claim that CAES has  
53 the lowest storage system cost for load-shifting and frequency support [140]. Rastler (2008) concludes  
54 that CAES, offering a shorter construction time of 2–3 years and a better siting flexibility, appears to be a  
55 cost-effective storage alternative to PHES [164]. This claim is advocated by Kondoh et al. (2000), who  
56  
57  
58

1  
2  
3  
4 estimated the capital costs for CAES to be lower than for PHES [145]. The economics of CAES with  
5 RES is improved if arbitrage and ancillary services are considered [191]. In the Danish electricity system,  
6 CAES is not an economically attractive choice for excess wind electricity production, unless it can defer  
7 investments in generation capacity [192]. However, in Germany, CAES can be economic under certain  
8 wind penetration levels. [193].  
9

10  
11 As to integration with renewable power, CAES plants are suitable for preventing wind power curtailment  
12 and for time-shifting energy delivery [78]. For example, the Huntorf CAES plant has been successfully  
13 used to level variable wind power [194]. Several simulations reaffirm that CAES is capable of smoothing  
14 fluctuating wind power [195], increasing wind power penetration [188], while meeting loads, reserve  
15 requirements and emission constraints [154]. However, in the Danish energy system, CAES may have  
16 problems with absorbing excess wind [196].  
17  
18

### 19 20 **5.2.3 Hydrogen**

21 Hydrogen can be used as a chemical storage for electric energy. A hydrogen-based electricity storage  
22 system consists of three main components: an *electrolyser* that produces hydrogen from water with  
23 electricity; an electricity-producing *fuel cell* that does the reverse; and a separate hydrogen *container*  
24 [171,197].  
25

26  
27 Hydrogen has a high energy capacity of 122 kJ/g, around 2.75 times greater than hydrocarbon fuels [198],  
28 though it has a low volumetric energy capacity due its low density. Hydrogen can be stored as  
29 compressed gas [199–202], cryogenic liquid [202], in solids (metal hydrides, carbon materials) [203] and  
30 in liquid carriers (methanol, ammonia) [171], though large-scale hydrogen storage is still challenging and  
31 expensive. Converting hydrogen to electricity in a fuel cell produces only water vapor as a side product. If  
32 clean energy sources are employed then the whole storage cycle could be environmentally friendly [204].  
33  
34

35  
36 A major problem with hydrogen electrical storage round-trip efficiency which remains at 35-50%  
37 [146,205]. In a demonstration project with hydrogen storage, wind turbines, photovoltaic panels and  
38 micro-hydroelectric turbines in the U.K., the round-trip efficiency achieved (electricity-hydrogen-  
39 electricity) was only 16%, which “plainly highlights the limitations of using hydrogen for energy storage”  
40 [206]. On the other hand, a major benefit over e.g. batteries is that the power rating and storage capacity  
41 of the system can be separated enabling also a long-term electrical storage capability.  
42  
43

44  
45 Several studies on hydrogen electrical storage indicate its potential usefulness for integrating renewable  
46 power generation [207]. First real hydrogen electrical storage systems with PV were piloted in the early  
47 1990s [197]. In Norway, a full-scale combined wind power and hydrogen plant has been in operation  
48 since 2005 [208,209]. A similar demonstration called PURE in the island of Unst, Scotland started in  
49 2001 [210]. In Germany, the PHOEBUS demonstration plant supplied photovoltaic power to part of the  
50 local Central Library for 10 years [211].  
51  
52

53  
54 Hydrogen is sometimes linked to the hydrogen energy economy in which hydrogen would be the one of  
55 the main energy carriers, enabling the shift to a carbon-free energy system. The hydrogen economy would  
56 definitely have a strong link to renewable power integration, but the whole concept is still highly  
57 debatable and not yet realizable, there being several pros and cons involved [201,206,212–215].  
58  
59

#### 5.2.4 Batteries

A rechargeable electrochemical battery, or a secondary battery, is a chemical energy storage based on two electrodes with different electron affinities. When a battery is discharged, electrons spontaneously move “downstream” to the electrode with higher affinity. When it is charged, an external voltage is applied to force electrons “upstream” to the electrode with lower affinity. A lithium-ion battery operates on a slightly different principle as here lithium ions are intercalated into the electrode materials and they are transported back and forth (along with electrons in the external conductor) during charge and discharge. [216].

There are many different battery technologies available, based on their chemical properties. Each battery type has its own advantages and disadvantages in terms of energy and power density, efficiency and cost. As most batteries have self-discharge losses as well, they are mainly feasible for short-term storage. Another disadvantage is that their performance reduces with increasing number of cycles. The capital cost and replacement cost of batteries dominates the cost of stored energy with batteries, while operation and maintenance costs are much less significant [217].

Batteries have near-instantaneous response times, which is a valuable feature for improving network stability [146] e.g. with renewables. The main use is providing power quality, short-term fluctuation reduction and some ancillary services or transmission deferral [22,78]. Batteries are modular in size enabling flexible siting e.g. close to load or production, or even changing location over the life-time [22].

Batteries for integrating variable renewable generation are already in use. For example in Futumata, Japan, a 51 MW wind farm is supported by a 34 MW sodium-sulphur-battery [218]. The benefits of a battery for PV and wind have also been verified through simulation studies [219–221].

Next, different battery types are briefly described and compared, while the key parameters are shown in Table 5 [222].

*Lead-acid* battery is a mature battery technology that has been used for decades in the vehicle industry [144]. They have the lowest cost per unit energy capacity, but also low specific energy [223].

*Nickel-cadmium* battery is also a mature technology, but has a higher energy density than lead-acid and is robust to deep discharge and temperature differences [141]. Unfortunately, Cadmium is highly toxic, the cell voltage is low and the battery is subject to memory effect [223,224].

*Nickel-metal hydride* battery is a variant of nickel-cadmium and is used in consumer electronics and electric vehicles [171]. The energy density is higher and there are no toxic materials, but the self-discharge rate is high and there is a dependency on rare earth minerals [141].

*Sodium-sulphur* battery is a high temperature battery that operates at 300–350°C. They have low maintenance requirements, can reverse quickly between charging and discharging and can also provide pulse power [141]. The disadvantages include the need for heating when the battery is not in use, corrosion problems, and safety issues due to volatile constituents [171,223].

1  
2  
3  
4 *Sodium-nickel-chlorine* (also known as *Zebra*) battery is also a high-temperature battery with an operating  
5 temperature of 300–350°C [141]. They are safer than sodium-sulphur batteries and are robust to  
6 overcharge and overdischarge [171,223].  
7

8  
9 Finally, the *lithium-ion* battery is deployed widely in the market for small appliances. They have high  
10 efficiency, good energy density and low self-discharge rate. For the moment, though, they are still  
11 expensive for large-scale power [141,225].  
12

13  
14 *Flow batteries* are a special type of battery resembling a reversible fuel cell. In a flow battery, the  
15 electrolyte is stored in separate tanks external to the electrochemical cell that converts electricity to  
16 chemical energy and vice-versa. The power capacity is determined by the area of the electrode, while  
17 energy capacity is determined by the volume of the electrolyte [171]. As these parameters are independent  
18 of one another, power and energy are decoupled, allowing greater flexibility in design as in the hydrogen-  
19 electricity storage concept. Commercially available flow battery chemistries include vanadium, zinc  
20 bromide and polysulphide bromide, also called *redox* flow batteries [144]. Though not yet in larger use  
21 [78], megawatt-hour-scale flow battery projects have been developed by e.g. Prudent Energy [226].  
22 Banham-Hall et al. (2012) has studied vanadium redox flow batteries as part of a wind farm concluding  
23 that vanadium redox flow batteries could provide frequency regulation and shifting of power [227]. Wang  
24 et al. (2010) also found that vanadium redox batteries can smooth the power output of a wind farm, in  
25 addition to providing reactive power to the grid [228].  
26  
27  
28  
29

### 30 **5.2.5 Flywheels**

31 Flywheels store energy in the angular momentum of a fast rotating mass, made e.g. of an advanced  
32 composite material such as carbon-fiber or graphite [244]. The flywheel is connected to an electric motor  
33 and generator for electricity-kinetic energy-electricity conversion. To minimize friction losses, special  
34 magnetic bearings are used and the flywheel may be put into a container with low-friction gas such as  
35 helium [146,171].  
36  
37

38 Flywheels have a long life with virtually zero maintenance and infinite recyclability, high power and  
39 energy densities [78,144] and a rapid response time [146]. They are resistant to temperatures and deep  
40 discharge and have simple charge level monitoring [245]. The efficiency at rated power is also high,  
41 around 90% [78,144,159]. Disadvantages include modest energy capacity [171], high self-discharge rate  
42 on the order of 0.5% of stored energy per hour [246] and safety issues due to high-speed moving parts  
43 [245].  
44  
45  
46

47 Flywheel energy storage can improve power quality and minimize fluctuation of wind power  
48 [139,236,247]. If connected to a variable-speed wind generator, a flywheel can smooth the power  
49 delivered to the grid or control the power flow to deliver constant power [248]. A flywheel energy storage  
50 system could be highly capable of stabilizing network frequency and voltage [249].  
51  
52

53 Flywheels may compete with chemical batteries as both are mainly suitable for frequent short-term charge  
54 and discharge [142,171]. A flywheel has an advantage through a longer lifetime [139,140] and its power  
55 is not limited by the electrochemistry but rather by the power electronics. The energy-specific cost of a  
56 battery is generally lower, but the power cost is higher than in a flywheel storage system [140].  
57  
58

### 5.2.6 Superconducting magnetic energy storage

In a superconducting magnetic energy storage (SMES), electricity is stored in a magnetic field generated by a direct current flowing in a large superconducting coil. One could describe SMES as an inductor with superconducting windings [250]. Energy is added and extracted simply by increasing or decreasing the current flow. As long as the coil is superconducting, no energy is dissipated [250]. Therefore, energy losses would occur only during AC/DC conversions. The response time is around 20 milliseconds [146] and the round-trip efficiency is high, around 90% [141,146]. SMES systems have high durability and reliability with low maintenance requirements [141,250]. The downsides include very high cost, around \$2000–3000/kW, and the requirement to be kept at very low temperature to maintain superconductivity [141,146].

SMES can be used for short-duration storage, e.g. for power quality and small-sized applications [141,145]. Feasibility studies of SMES for high wind penetration in a microgrid have shown significantly enhanced dynamic security and stability of the power system [251].

### 5.2.7 Supercapacitors

Supercapacitors or ultracapacitors store energy in the electric field produced by a separation of charges. In an electrochemical double layer capacitor, electricity is stored using ion adsorption. In a pseudocapacitor, electricity is stored through fast surface redox reactions. Hybrid capacitors combine both capacitive and pseudo-capacitive electrode with a battery electrode [252].

Supercapacitors have exceptionally high efficiency, good tolerance for low temperatures, very low maintenance requirements, fast response time, extreme durability and high specific power. However, they can only provide electricity for a very short time period (minutes), have high per-watt cost and self-discharge and low specific energy [68,141,229].

Supercapacitors have a potential in suppressing short-term fluctuations in wind power output [253,254], but for longer-term smoothing, they may need to be combined with other energy storage options such as batteries. Li et al. (2010) found that including a supercapacitor in a flow battery-wind-system lowers battery cost, extends battery life and improves overall efficiency [255]. In a battery-solar-system, supercapacitors may reduce the capacity requirement for the battery while increasing its lifetime [256].

## 5.3 Power vs. discharge time characteristics of different electric storage technologies

The choice of the electric storage technology has to be done on a case-by-case basis as there is no universal technology solution available. One way to screen out suitable storage options for an application, e.g., for RE power, would be to consider the characteristic power and discharge times of storage technologies as shown in Fig. 2.

PHES and CAES technologies are characterized by high energy and power capacities, but they are site-dependent and meant for large applications. SMES, supercapacitors and flywheels have a very fast response time, their use is not bound to a site, but their energy capacity (or discharge time) is limited. Batteries can be considered as a kind of bridging technology between bulk storage and high-fidelity

1  
2  
3  
4 storage, e.g. for applications in which flexibility is desirable. Unfortunately, batteries are currently limited  
5 by their short operational lifetimes.  
6  
7

## 9 **6 Supply-side flexibility**

10 The power balance of electric systems is normally handled by the supply side (e.g., power plants). With  
11 supply-side flexibility, we mean measures or technologies through which the output of power generation  
12 units can be modified to attain the power balance in the grid, e.g., when large amounts of variable RE  
13 power is in use.  
14  
15

### 16 **6.1 Power plant response**

17 Power plants are divided into three categories based on their flexibility: base load, peaking, and load  
18 following power plants. Base load power plants (e.g., coal, nuclear) are run at almost constant power,  
19 preferably at nominal power level. Ramping or shut-down of base load power plants is avoided due to  
20 economic and sometimes technical reasons. Peaking power plants are used irregularly, e.g., during high  
21 demand. Load-following plants balance demand and supply at each moment. Hydropower and gas  
22 turbines are typical examples in this category. The start-up or ramping response is very quick from  
23 seconds to some minutes. Table 6 summarizes key indicators of different power plant technologies  
24 including flexibility characteristics. [68]  
25  
26  
27  
28

29 Fig. 3 shows typical start and ramping response of different power plant technologies also relevant for RE  
30 power integration. Gas engines have the fastest cold-start response and could reach full power within  
31 some minutes, combined-cycle gas turbines may need 1–2 hours and base load steam plants several hours,  
32 respectively.  
33  
34

### 35 **6.2 Curtailment**

36 A simple way to regulate large amounts of VRE power in the energy systems would be curtailment, i.e.,  
37 limiting the power output. Situations in which curtailment may be necessary include limited transmission  
38 capacity [257], oversupply of VRE power, and too large share of inflexible base load generators.  
39 Curtailment is also applicable to dampen quick changes in power output by rapidly reducing generation,  
40 or it can provide reserve power capacity through a ramp-up margin [36,258].  
41  
42  
43

44 Curtailment means always losing some electricity, but could be avoided if overall power system  
45 flexibility were increased, e.g., with less must-run base load power plants in the system or using load-  
46 shifting if the VRE power share is very high [29]. On the other hand, as the capacity factor or VRE is  
47 much less than 1, the loss of electricity produced is not proportional to the power curtailed. This is well  
48 demonstrated by Fig. 4 which shows the yearly electricity loss versus curtailment for a PV system in  
49 Finnish climate: e.g., an average curtailment of PV power by 40% leads on a yearly level to 10% loss in  
50 PV electricity produced.  
51  
52  
53

54 Curtailment for PV systems is in practice realized through the inverters either as on-off control or droop  
55 control, where the PV production is gradually reduced [259,260]. Several studies are available on the  
56 effects of PV curtailment [261–265]. Tonkoski and Lopes (2011) [260] further discuss active power  
57  
58  
59  
60  
61  
62  
63  
64  
65

1  
2  
3  
4 curtailment (APC) techniques in residential feeders to even out the curtailment needs among all  
5 households along the feeder.  
6

7  
8 In case of wind power, network congestion is often the reason for curtailing wind power [266]. With  
9 higher wind shares, supply and demand mismatches are frequently the reason for curtailing. Curtailing  
10 wind power is technically simple and it can be based on different criteria such as mutual agreements and  
11 regulation [257]. Several studies have analyzed the role of wind power curtailment in the national power  
12 systems, e.g., Ireland [267], Germany [257,268], Spain and the USA [257,269]. Practical experiences  
13 with wind power also demonstrate the use of curtailments, e.g., in Germany, 1% of the wind energy  
14 produced was lost for this reason due to problems with regional distribution networks and transmission-  
15 level bottlenecks [268].  
16  
17

### 18 19 **6.3 Combined-cycle gas turbines**

20 Combined-cycle gas turbines (CCGT) [270] are an attractive option to increase the energy supply  
21 flexibility. A CCGT have typically a ramping rate of 10 MW per minute [36]. The investment cost is low  
22 and the efficiency is high up to 60%. [271,272]. The CO<sub>2</sub> emissions are only half of those of coal-fired  
23 plants. A major drawback for CCGT is the high fuel cost [273], which may decrease the attractiveness of  
24 CCGT as a balancing power and marginalizes its use in the electricity markets. Combining a gas and VRE  
25 system could be quite attractive as such [274–277] to compensate for VRE power fluctuations.  
26  
27

### 28 29 **6.4 Combined heat and power (CHP)**

30 Combined heat and power (CHP) plants produce simultaneously heat and power leading to a high overall  
31 conversion efficiency (>80%) [278,279]. Combining RE and CHP offers several advantages, e.g., when  
32 combined with thermal storage that enables load shifting. Furthermore, combining different technologies  
33 in a CHP plant (e.g., gas engines, heat pumps, heat storage, peak-load gas boilers, electric boiler) could  
34 increase the inherent flexibility of CHP [280–285].  
35  
36  
37  
38

## 39 **7 Advanced technologies**

40 In the next, we present future strategies for dealing with large-scale RE schemes in which surplus RE  
41 production is utilized for different purposes, i.e., combining new loads to the power systems such as  
42 heating or cooling demand, electric vehicles and power-to-gas schemes. In this way, wasting the  
43 electricity from curtailment of RE power could be reduced or even avoided.  
44  
45  
46

### 47 **7.1 Electricity-to-thermal (E2T)**

48 In an electricity-to-thermal (E2T) strategy, excess renewable electricity is converted into thermal energy,  
49 either for heating or cooling purposes [286]. Generally, the demand of thermal energy dominates the final  
50 energy use, and it is also easier to store thermal energy than electricity.  
51  
52

53 An E2T option adds flexibility to the power system, and reduces emissions from heating plants if it  
54 replaces heat production from fossil fuels. Some studies show that E2T could significantly increase the  
55 useful share of RES, even 2–3 fold the self-use limit for RE power [20,287–289].  
56  
57



1  
2  
3  
4 The main technologies needed for E2T are electric boilers, pumps and to some extent thermal storage  
5 [20,290,291]. E2T can be very efficient [160,291] and economical, too [290,291]. As a real-world  
6 example, Jilin province in China has used curtailed wind power to replace coal-fired heating [292].  
7  
8

## 9 **7.2 Power-to-Gas (P2G) and Power-to-Hydrogen (P2H)**

10 Having excessive electricity available enables also to produce high-value energy products such as  
11 hydrogen (through electrolysis or photoelectrolysis) and synthetic methane (through H<sub>2</sub> and the Sabatier  
12 process in which CH<sub>4</sub> and H<sub>2</sub>O are catalytically produced from CO<sub>2</sub> and H<sub>2</sub>) [293–295].  
13  
14

15 Pure hydrogen production from RE power could also be seen as a sort of power storage as H<sub>2</sub> can be  
16 converted back to electricity in fuel cells or by combustion power plants. Synthetic CH<sub>4</sub> from RE could  
17 employ the gas distribution systems which has a large storage capacity (e.g., in Germany, it is over 200  
18 TWh) [293]. Also hydrogen to some extent could be transported in these systems [296]. Several studies  
19 have envisioned P2H as part of a hydrogen economy [297,298], or part of the transportation system [299].  
20 Gahleitner [300] gives a good review of P2G pilot plants under planning or operation. Typically most of  
21 these plants use wind or solar power. Combining different energy carriers into an energy hub to provide  
22 more flexibility for large-scale RE power has also been presented [287,301–304].  
23  
24  
25

## 26 **7.3 Vehicle-to-grid (V2G)**

27 Electric vehicles could provide a distributed, moving energy storage service in addition to the stationary  
28 options discussed above. Using electric vehicles (EV) or plug-in electric vehicles (PEV) for active energy  
29 storage linked to the grid is called *vehicle-to-grid* (V2G) strategy.  
30  
31

32 Most of its time, a vehicle is idle and thus offers an option for charging or discharging if equipped with a  
33 battery [305]. The charging window of EVs and PEVs is relatively long, 8–12 hours, and the charging  
34 duration relatively short, around 90 minutes, offering considerable flexibility [78].  
35  
36

37 V2G could include services such as scheduled energy, power quality, reserve power, regulation,  
38 emergency load curtailment, energy balancing, and RE integration [306–309], but requires the suitable  
39 equipment (e.g. telemetry, two-way communications) and the assistance of aggregators [78,310] that  
40 lump several PEVs together to achieve the required scale. Some services may require discharging of the  
41 battery, which causes additional loss of cycle life [311] and an economic disadvantage [312]. Varying the  
42 charging power while keeping it positive allows PEVs to provide demand response and grid reliability  
43 services without causing additional wear to the battery [78]. Different smart charging schemes may be  
44 employed to minimize adverse effects from V2G to the energy system or battery [308,309,313,314].  
45  
46  
47

48 V2G services could directly assist integration of renewable power. Kempton et al. (2005) calculated that  
49 V2G in the U.S. could stabilize large-scale (50% of U.S. electricity) wind power with 3% of the vehicle  
50 fleet dedicated to regulation for wind and 8–38% to provide operating reserves or storage [315]. Ekman  
51 (2011) investigated the effects of different charging strategies on the balance between wind power  
52 production and consumption in a future Danish power system. Ekman finds that increased PEV  
53 penetration will reduce the excess of wind power, but PEVs alone will not be sufficient to fully utilize the  
54 wind power potential. Other balancing mechanisms will be needed if the wind penetration exceeds 50%  
55  
56  
57

1  
2  
3  
4 [307]. Kaewpuang and Niyato (2012) inspected power management in a smart grid network with multiple  
5 energy resources, including wind. They concluded that energy generation from conventional power plants  
6 can be apparently reduced using PEV integration, while also reducing the overall generation costs [316].  
7 In domestic applications, Yoshimi et al. (2012) find that V2G can be used to increase the rate of  
8 utilization of PV-generated electricity, cut CO<sub>2</sub> emissions and lower the costs of purchased electricity  
9 [317].  
10  
11

## 12 **8 Infrastructure**

### 13 **8.1 Grid infrastructure**

14 Sufficient transmission capability is essential for power system flexibility [67,318]. Robust and well-  
15 designed grids with appropriate grid codes [258] can balance large local differences in supply and  
16 demand, offering strong spatial interconnections. Furthermore, well-functioning energy markets need  
17 well-functioning transmission lines. Three future developments in grid infrastructure, namely supergrids,  
18 smart grids, and microgrids will be discussed here.  
19

#### 20 **8.1.1 Supergrids**

21 Supergrid is a strong network of transmission lines typically incorporating at high-voltage direct current  
22 (HVDC) technology [319–324]. Such a grid is capable for connecting remote RE power sites with  
23 demand. HVDC transmission lines have already been realized in subsea cables, but not yet in  
24 intercontinental context where high voltage AC would still dominate. Main challenges with HVDC are  
25 related to installation, technical standards, interaction with AC grid, and operational principles  
26 [319,320,324].  
27

28 There are several studies envisioning supergrids in connection with VRE, e.g., wind power in the North  
29 Sea [321,325,326], the DESERTEC project to connect large solar and wind farms in North Africa and  
30 Middle East with Europe [321,327,328]. The USA has planned a project to import large-scale wind power  
31 from North Atlantic to the Eastern coast of the country [321].  
32

#### 33 **8.1.2 Smart grids**

34 The Smart Grid (SG) concept has gained a lot of attention during the last years and it is perceived as a key  
35 technology for optimal renewable electricity integration [329–331]. Basically, it is a power grid where all  
36 key stakeholders (energy producers, consumers and network companies) are intelligently connected to  
37 each other. Smart grid includes integration of distributed power generation and storage technologies,  
38 advanced metering, robust two-way information communication, and vast automation. One important  
39 rationale of a smart grid is to increase the power supply reliability and to reduce ecological impacts by  
40 integrating all energy producers irrespective of size and consumers to participate in the grid optimization,  
41 which could then lead to major savings and carbon emission reductions [332].  
42

43 The literature on SG is ample [333–337]. See also [21] for a recent review. In addition to technological  
44 innovations, the SG development may also include redesign of the structure of the electricity market.  
45 Accurate forecasts on weather, load and markets (short term), and future development of energy demand  
46  
47  
48  
49  
50  
51  
52  
53

1  
2  
3  
4 (long term) also becomes important in this context [335,336,338–341]. Storage could be a key technology  
5 for future SGs [342]; communication technology is another important topic [343–345]. Future  
6 developments of the SG could include the so-called super-smart grid which combines the advantages of a  
7 supergrid and a smart grid. [345,346].  
8  
9

### 10 **8.1.3 Microgrids**

11 Microgrids [347–349] have been proposed as one solution for integrating RE into the power system and  
12 balancing supply–demand mismatch [350]. Microgrids are local grids to supply electricity to local  
13 consumers. A microgrid energy system may include local power generation (micro-CHP, small-scale  
14 RE), storage systems, controllable loads and the feeder system. Within a larger power distribution system,  
15 the microgrids could be operated as a component of the larger grid system to balance voltage fluctuations.  
16 During disturbances, they can be isolated from the larger system (island mode) to secure the energy  
17 supply in its own area. Several real-world examples of microgrids are listed in [351].  
18  
19  
20

## 21 **8.2 Smoothing effects of spatial power distribution**

22 Spatial power fluctuations can be smoothed out through efficient power transmission and distribution.  
23 Spreading out RE power generation on a wider area can reduce rapid changes in renewable power output.  
24 Smoothing effects are well-known from wind energy utilization [338,352–358] and they can positively  
25 affect the value of wind power at high penetration levels. Different portfolio theories have been used to  
26 show how geographical dispersing of wind power generation can reduce the wind power variability  
27 [359,360]. References [361–363] show that geographical smoothing could be linked to solar power as  
28 well.  
29  
30  
31  
32  
33

## 34 **9 Electricity markets**

35 Though energy system flexibility is often perceived as a technological issue only, it has a strong link to  
36 the electricity market as well. For example, different power tariffs may enhance flexibility. On the other  
37 hand, fuel-less energy sources such as wind and solar power have a zero-marginal cost on the market,  
38 meaning that large-scale RE schemes would drop the average electricity price. Poor market design may  
39 limit access to technical flexibility in energy systems [258]. In the next, we will discuss more market  
40 issues related to flexibility and renewables.  
41  
42  
43

### 44 **9.1 Impact of variable renewable energy production to electricity markets**

45 On short term, variable renewable electricity production such as solar and wind with close to zero  
46 variable costs will reduce the electricity price on the wholesale spot market. Much of VRE production has  
47 also been supported by the feed-in-tariffs meaning that, all VRE production has in practice been fed to the  
48 market [364]. Even negative spot prices have been witnessed during high renewable production and low  
49 demand [364,365]. On the German market each additional GWh of VRE power fed to the grid has  
50 lowered the spot market price of electricity by \$1.4–1.7/MWh [65]. However, the consumer electricity  
51 price may rise due to the VRE feed-in-tariff: in Germany, it has increased over 20% from 2008 to 2012  
52 [366].  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

1  
2  
3  
4 On long term, increasing renewable power will decrease the demand for base load power plants and  
5 increase the demand for peak load capacity [365]. This shift of conventional generation capacity and  
6 increasing fluctuation of net load will increase the price volatility [365]. As the predictability of variable  
7 renewable energy sources is low on the day-ahead market, the demand for balancing services and intraday  
8 trading will consequently increase [367,368]. The costs of RE and wholesale prices will also influence  
9 investment, expansion and retiring decisions of transmission and generation in the long run, making the  
10 average effect of RE on wholesale prices less clear than on short term [2].  
11  
12

## 13 14 **9.2 Market design to increase flexibility**

15 As the forecast errors generally decrease with a shorter prediction horizon [339,369,370], more frequent  
16 trading and reserve procurement allows for lower regulation costs and increased incomes for producers of  
17 renewable electricity [369,371], though some additional costs may also occur [371]. However, more  
18 frequent energy trading is not straightforward as intra-day markets are prone to low liquidity [367,371].  
19 Intra-day auctions could be an attractive option for increasing intra-day market liquidity [367].  
20  
21

22  
23 Internal self-balancing by the large power-generating companies based on up-to-date production forecasts  
24 just shortly before the hour of delivery, has also been suggested for balancing forecast deviations [372],  
25 but with some concerns of its value [372] and market power implications [367]. Production forecasts can  
26 also be improved through incorporating on-line production, ensemble forecasting and increasing the  
27 forecast area [133,369]. The forecast methodologies themselves are also subject to continuous  
28 development [133,339].  
29  
30

31  
32 With a higher scheduling resolution, changes in production during a shorter interval become smaller and  
33 more manageable [371]. This would reduce the need for regulation reserves [371]. Higher temporal  
34 resolution would also provide timely price signals to flexible resources and shift risks from system  
35 operator to balance responsible parties; however, start-up costs could bring challenges [373].  
36

37  
38 Location-dependent pricing could be used to mitigate congestion due to intermittent generation [368,373].  
39 Nodal pricing appears to be the only option that would reflect the state of the physical power system at all  
40 times, as it is impossible to achieve that with zonal pricing. This principle applies to both domestic and  
41 international transmission capacity allocation [373]. Price caps if being high enough could facilitate fixed  
42 cost recovery by peaking units, and price floors should be low enough to reveal the value of flexibility,  
43 e.g. allowing negative prices [373].  
44  
45

46  
47 Integration of electricity markets, both spatially and the spot, intraday and reserve markets in a given area,  
48 could increase flexibility. Reserve market auctions should be aligned with the spot and intraday markets:  
49 if plants are committed for reserve for a much longer time than the electricity market timeframe,  
50 flexibility will be reduced [364]. Aggregation of markets over large areas provides access to more  
51 generators and loads to provide flexibility, brings about geographical smoothing, and allows for sharing  
52 of reserves, which reduces costs [258]. An auction mechanism for interconnector capacities between  
53 European power markets would increase the flexibility of the entire system [364]. However, the  
54 renewable production integration cost reduction from cross-border transmission depends on the  
55 generation mix in the neighboring countries: if VRE is largely used in both areas, the cost-saving  
56  
57

1  
2  
3  
4 potential of the interconnection decreases [374]. Moreover, the correlation of VRE production in the  
5 interconnected areas strongly affects the generation cost reduction due to an interconnector [375].  
6 International market integration is being pursued in Europe with a pilot project for day-ahead market  
7 coupling recently started by 15 countries [376].  
8  
9

10 Stochastic unit commitment, instead of deterministic, is a way to directly include uncertainty of  
11 renewable energy production to operational planning [371]. However, all stochastic information cannot be  
12 included in practice, and solution times of the optimization can be excessive.  
13  
14

15 The support scheme for VRE production strongly affects the flexibility of the VRE production itself.  
16 With a constant feed-in tariff in combination with priority purchase and transmission rules, renewable  
17 producers are shielded from market signals [377]. A feed-in premium was introduced as optional for the  
18 feed-in tariff in Germany in 2012. It incentivizes to respond to short-term price signals, encouraging  
19 voluntary curtailment when the magnitude of a negative electricity spot price exceeds the premium, while  
20 keeping the producers shielded from market price risks. For example, in December 2012, 300 MW of  
21 wind curtailment was observed during negative price conditions [377]. A feed-in premium can be  
22 considered a good trade-off solution, as it exposes renewable producers to market signals without creating  
23 considerable new risks and transaction costs [378].  
24  
25  
26

27 A major question in market design for integration of VRE is whether VRE production should follow the  
28 same market rules than the other production after it has become competitive. The same market rules could  
29 be incorporated if dynamic retail pricing schemes were in place to cover capital costs for capacity  
30 investment [373]. When the penetration of variable renewable production increases, there will be an  
31 increasing need to allocate some balancing responsibility to VRE as well, which may require special  
32 measures for balancing markets [379].  
33  
34  
35

36 With lack of demand response and increasing VRE share, energy-only markets may not be sufficient to  
37 ensure that flexible energy plants could recover their costs for which reason some kind of capacity  
38 mechanism may be needed [373,380]. The situation could be corrected with a price-based or quantity-  
39 based capacity system. In the former, the price of capacity per MW is fixed; in the latter, the amount of  
40 desired capacity is fixed, either as installed capacity or operating reserve. However, if capacity bids are in  
41 use on the reserve market, the energy price on reserve markets may get lower than on the intra-day  
42 market, creating distorting incentives [367]. As it is difficult for VRE to provide capacity, implementing a  
43 capacity mechanism would most likely lead to different market rules between VRE and conventional  
44 generation [373].  
45  
46  
47

48 Aggregating different VRE generators to “virtual power plants” could reduce the hours with low spot  
49 prices, but could increase the cost of electricity for consumers [368]. Moreover, it wouldn’t solve grid  
50 congestion problems.  
51  
52

53 A pool market design, common in American markets, has advantages with regard to flexibility compared  
54 to the bilateral markets with a power exchange, used in most European countries. The gate closure is later,  
55  
56  
57

1  
2  
3  
4 the intra-day market is more liquid, and the balancing and intra-day markets are not separated, which  
5 more readily allows for the use of up-to-date forecast information [368].  
6

### 7 **9.3 Energy storage in the electricity market**

8  
9 Energy storage was recognized as a high potential technology for energy system flexibility, but its role on  
10 the market is somewhat complex as it has both a demand and supply function and therefore it does not fit  
11 well into existing regulatory frameworks [381]. This in turn may discourage investments in energy  
12 storage [382–384]. Furthermore, price distortions, grid fees and the lack of price transparency may create  
13 a negative cost impact on energy storage [9].  
14  
15

16 IEA suggests that policymakers should enable compensation for the multitude of services energy storage  
17 provides, e.g. payment based on the value of reliability, power quality, energy security and efficiency  
18 gains. Potential mechanisms include real-time pricing, pricing by service and taxation being applied to  
19 final products. In the U.S., efforts have been made to enable incentives to energy storage, e.g. through  
20 opening electricity markets to energy storage and permitting companies other than large utilities to sell  
21 ancillary services [9].  
22  
23  
24

### 25 **9.4 DSM in the electricity market**

26 Price-based DSM increases demand elasticity and hence it could reduce price spikes [31]. DSM can also  
27 shift market power from generators to consumers [37], reduce prices [385] and price volatility [50], and  
28 make the market more efficient [385]. In many electricity markets where VRE has priority, price is  
29 negatively correlated with VRE production [35] and hence price-based DSM can provide flexibility for  
30 VRE integration directly. However, the closed-loop feedback system between the physical and market  
31 layer created by real-time pricing, together with increasing VRE production, may lead to increased  
32 volatility [386]. Large-scale system models including the interactions between the market and physical  
33 system are needed for full understanding of DSM effects [37].  
34  
35  
36

37  
38 Market rules affect the possibility of DSM to enter different markets. For example, auctions on primary  
39 and secondary reserves in Germany are held 1 month and 6 months before delivery, which may be too  
40 restrictive for DSM providers [33].  
41  
42  
43

## 44 **10 Conclusions**

45 The number of options to improve energy system flexibility when increasing the share of renewable  
46 power in electricity production is large. It is likely that this theme will draw even more interest in the  
47 years to come as the prospects for new renewable energy technologies [387–391] are positive and further  
48 price reductions are expected. Energy system flexibility is definitely a “hot topic” as demonstrated by the  
49 large number of references contained in this review (close to 400). The options for energy system  
50 flexibility and their principles may remain much the same as described here, though the depth of  
51 information may improve in the future.  
52  
53  
54

55 We observed that much of energy system flexibility can actually be handled through the energy or power  
56 system itself, meaning that energy systems could have inherent capabilities to incorporate large shares of  
57  
58  
59  
60  
61  
62  
63  
64  
65

1  
2  
3  
4 variable power, without requiring massive changes or new investments. For example, employing a whole  
5 energy view in which the thermal and electric system are treated more as a whole rather than separate  
6 could offer major new opportunities for renewable power integration. It is also important to remind that  
7 the present power systems have already built-in flexibility capacity as the power demand is not constant  
8 over time, though introducing renewable power will change the net load patterns. However, in the long  
9 run, one may see more attention been paid to dedicated flexibility products, such as electricity storage,  
10 which are additional components to be added to the power system.  
11  
12

## 13 14 **Acknowledgements**

15  
16 The financial support of the Academy of Finland (Grant 13269795) is gratefully acknowledged.  
17  
18

## 19 20 **Figure captions**

21  
22 Figure 1. Categories of demand side management [30].  
23

24  
25 Figure 2. Power and discharge time of selected energy storage technologies [250,392,393].  
26

27  
28 Figure 3. Start-up and ramp-up times of three technologies after a five-days stop [68].  
29

30  
31 Figure 4. Lost energy as a function of curtailed power in a Finnish PV system. Power curtailment  
32 percentage is calculated in relation to nominal power (red curve) and maximum generated power (blue).  
33

## 34 35 **References**

- 36  
37 [1] Paatero JV, Lund PD. Effects of large-scale photovoltaic power integration on electricity  
38 distribution networks. *Renew Energy* 2007;32:216–34.  
39  
40 [2] Holttinen H. Wind integration: experience, issues, and challenges. *Wiley Interdiscip Rev Energy*  
41 *Environ* 2012;1:243–55.  
42  
43 [3] The Danish Government. The Danish Climate Policy Plan: Towards a low carbon society. 2013.  
44  
45 [4] The Press and Information Office of the Federal Government. Switching to the electricity of the  
46 future. *Arch Der Bundesregierung* 2011:1.  
47  
48 [5] Morales A. Further Spanish Energy Reform Could Mean “Nasty Revenue Cut” for Renewable.  
49 *Renew Energy World* 2013:1.  
50 [http://www.renewableenergyworld.com/rea/news/article/2013/07/spain-says-energy-reform-to-](http://www.renewableenergyworld.com/rea/news/article/2013/07/spain-says-energy-reform-to-cost-companies-2-7-billion)  
51 [cost-companies-2-7-billion](http://www.renewableenergyworld.com/rea/news/article/2013/07/spain-says-energy-reform-to-cost-companies-2-7-billion) Accessed: 17/11/2014  
52  
53  
54  
55  
56  
57

- 1  
2  
3  
4 [6] Milman O. Solar Council campaigns against Tony Abbott over renewable energy target. *Guardian* 2014;1. <http://www.renewableenergyworld.com/rea/news/article/2013/07/spain-says-energy-reform-to-cost-companies-2-7-billion> Accessed: 17/11/2014
- 5  
6  
7  
8  
9 [7] United Press International. France begins “energy transition” debate. *United Press Int* 2012. [http://www.upi.com/Business\\_News/Energy-Resources/2012/11/28/France-begins-energy-transition-debate/UPI-99421354078980](http://www.upi.com/Business_News/Energy-Resources/2012/11/28/France-begins-energy-transition-debate/UPI-99421354078980) Accessed: 17/11/2014
- 10  
11  
12  
13 [8] The European Wind Energy Association. *Wind in power: 2013 European statistics*. 2014.
- 14  
15 [9] International Energy Agency. *Technology Roadmap: Solar Photovoltaic Energy*. 2014.
- 16  
17 [10] International Energy Agency. *Technology Roadmap: Wind Energy*. 2013.
- 18  
19 [11] The European Wind Energy Association. *EU Energy Policy to 2050: Achieving 80-95% emissions reductions*. 2011.
- 20  
21  
22 [12] U.S. Energy Information Administration. *Annual Energy Outlook 2013 with Projections to 2040*. 2013.
- 23  
24 [13] Scoria H, Sopinka A, van Kooten GC. The economics of storage, transmission and drought: integrating variable wind power into spatially separated electricity grids. *Energy Econ* 2012;34:536–41.
- 25  
26  
27 [14] Toledo OM, Oliveira Filho D, Diniz ASAC. Distributed photovoltaic generation and energy storage systems: A review. *Renew Sustain Energy Rev* 2010;14:506–11.
- 28  
29 [15] Montgomery J. The Case for Distributed Energy Storage. *Renew Energy World* 2013;1.
- 30  
31 [16] Molina MG. Distributed energy storage systems for applications in future smart grids. *Transm. Distrib. Lat. Am. Conf. Expo.*, 2012, p. 1–7.
- 32  
33 [17] Paatero JV, Lund PD. Effect of energy storage on variations in wind power. *Wind Energy* 2005;8:421–41.
- 34  
35 [18] Converse AO. Seasonal Energy Storage in a Renewable Energy System. *Proc IEEE* 2012;100:401–9.
- 36  
37 [19] Zhang Q, Ishihara KN, Mclellan BC, Tezuka T. An analysis methodology for integrating renewable and nuclear energy into future smart electricity systems. *Int J Energy Res* 2012;36:1416–31.
- 38  
39 [20] Kiviluoma J, Meibom P. Influence of wind power, plug-in electric vehicles, and heat storages on power system investments. *Energy* 2010;35:1244–55.
- 40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65



- 1  
2  
3  
4 [21] Fang X, Misra S, Xue G, Yang D. Smart Grid – The New and Improved Power Grid: A Survey. IEEE Commun Surv Tutorials 2012;14:944–80.  
5  
6  
7  
8 [22] Tuohy A, Kaun B, Entriaken R. Storage and demand-side options for integrating wind power. Wiley Interdiscip Rev Energy Environ 2014;3:93–109.  
9  
10  
11 [23] Aghaei J, Alizadeh M-I. Demand response in smart electricity grids equipped with renewable energy sources: A review. Renew Sustain Energy Rev 2013;18:64–72.  
12  
13  
14  
15 [24] O’Connell N, Pinson P, Madsen H, O’Malley M. Benefits and challenges of electrical demand response: A critical review. Renew Sustain Energy Rev 2014;39:686–99.  
16  
17  
18 [25] Koohi-Kamali S, Tyagi V V., Rahim NA, Panwar NL, Mokhlis H. Emergence of energy storage technologies as the solution for reliable operation of smart power systems: A review. Renew Sustain Energy Rev 2013;25:135–65.  
19  
20  
21  
22 [26] Mwasilu F, Justo JJ, Kim E-K, Do TD, Jung J-W. Electric vehicles and smart grid interaction: A review on vehicle to grid and renewable energy sources integration. Renew Sustain Energy Rev 2014;34:501–16.  
23  
24  
25  
26  
27 [27] Huber M, Dimkova D, Hamacher T. Integration of wind and solar power in Europe: Assessment of flexibility requirements. Energy 2014;69:236–46.  
28  
29  
30  
31 [28] Blarke MB. Towards an intermittency-friendly energy system: Comparing electric boilers and heat pumps in distributed cogeneration. Appl Energy 2012;91:349–65.  
32  
33  
34 [29] Denholm P, Hand M. Grid flexibility and storage required to achieve very high penetration of variable renewable electricity. Energy Policy 2011;39:1817–30.  
35  
36  
37  
38 [30] Gellings C, Smith W. Integrating demand-side management into utility planning. Proc IEEE 1989;77:908–18.  
39  
40  
41 [31] Kirschen D. Demand-side view of electricity markets. Power Syst IEEE Trans 2003;18:520–7.  
42  
43 [32] Kohler S, Agricola A-C, Seidl H, Höflich B. dena Grid Study II. Integration of Renewable Energy Sources in the German Power Supply System from 2015 – 2020 with an Outlook to 2025. 2010.  
44  
45  
46 [33] Paulus M, Borggreffe F. The potential of demand-side management in energy-intensive industries for electricity markets in Germany. Appl Energy 2011;88:432–41.  
47  
48  
49  
50 [34] Callaway DS, Hiskens IA. Achieving Controllability of Electric Loads. Proc IEEE 2011;99:184–99.  
51  
52  
53  
54 [35] Finn P, Fitzpatrick C, Connolly D, Leahy M, Relihan L. Facilitation of renewable electricity using price based appliance control in Ireland’s electricity market. Energy 2011;36:2952–60.  
55  
56  
57

- 1  
2  
3  
4 [36] International Energy Agency. *Harnessing Variable Renewables – A Guide to the Balancing*  
5 *Challenge*. 2011.  
6  
7  
8 [37] Mathieu J, Haring T, Andersson J. Residential demand response program design: Engineering and  
9 Economic perspectives. *Eur. Energy Mark. Conf.*, 2013.  
10  
11 [38] Cappers P, Mills A, Goldman C, Wiser R, Eto JH. *Mass Market Demand Response and Variable*  
12 *Generation Integration Issues: A Scoping Study*. 2011.  
13  
14 [39] Kim J-H, Shcherbakova A. Common failures of demand response. *Energy* 2011;36:873–80.  
15  
16 [40] Kazerooni AK, Mutale J. Network investment planning for high penetration of wind energy under  
17 demand response program. 2010 IEEE 11th Int. Conf. Probabilistic Methods Appl. to Power Syst.,  
18 2010, p. 238–43.  
19  
20 [41] Nourai A, Kogan VI, Schafer CM. Load Leveling Reduces T&D Line Losses. *IEEE Trans Power*  
21 *Deliv* 2008;23:2168–73.  
22  
23 [42] O’Dwyer C. Modeling demand response in the residential sector for the provision of reserves.  
24 *Power Energy Soc. Gen. Meet. 2012 IEEE, San Diego, CA: 2012*.  
25  
26 [43] Darby S. The effectiveness of feedback on energy consumption. A review for Defra of the  
27 literature on metering, billing and direct displays. 2006.  
28  
29 [44] Buckingham G. Remote control of electricity supplies to the domestic consumer. *Electron Power*  
30 1965.  
31  
32 [45] Schweppe F, Tabors R, Kirtley J, Outhred H, Pickel F, Cox A. Homeostatic utility control. *IEEE*  
33 *Trans Power Appar Syst* 1980;75:1151–63.  
34  
35 [46] Strbac G. Demand side management: Benefits and challenges. *Energy Policy* 2008;36:4419–26.  
36  
37 [47] Björk CO. *Industrial load management - Theory, practice and simulations*. 1989.  
38  
39 [48] Lisovich M, Mulligan D, Wicker S. Inferring personal information from demand-response  
40 systems. *Secur Privacy, IEEE* 2010:11–20.  
41  
42 [49] Gnauk B, Dannecker L, Hahmann M. Leveraging gamification in demand dispatch systems. *Proc.*  
43 *2012 Jt. EDBT/ICDT Work. EDBT-ICDT ’12, New York, New York, USA: ACM Press; 2012, p.*  
44 *103*.  
45  
46 [50] Albadi MH, El-Saadany EF. A summary of demand response in electricity markets. *Electr Power*  
47 *Syst Res* 2008;78:1989–96.  
48  
49 [51] Paulus M, Borggreffe F. Economic potential of demand side management in an industrialized  
50 country—the case of Germany. 10th IAEE Eur. Conf., Vienna, Austria: 2009.  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [52] Callaway DS. Tapping the energy storage potential in electric loads to deliver load following and  
5 regulation, with application to wind energy. *Energy Convers Manag* 2009;50:1389–400.  
6  
7  
8 [53] Bushnell J, Hobbs B, Wolak F. When it comes to demand response, is FERC its own worst  
9 enemy? *Electr J* 2009;22:9–18.  
10  
11 [54] Mathieu J. Characterizing the response of commercial and industrial facilities to dynamic pricing  
12 signals from the utility. *ASME's 4th Int. Conf. Energy Sustain.*, Phoenix, AZ: 2010.  
13  
14 [55] Segerstam J, Junntila A, Lehtinen J, Lindroos R, Heinimäki R, Hänninen K, et al. Sähkö-  
15 kysyntäjousto suurten loppuasiakasryhmien kannalta. 2007.  
16  
17  
18 [56] Dyson MEH, Borgeson SD, Tabone MD, Callaway DS. Using smart meter data to estimate  
19 demand response potential, with application to solar energy integration. *Energy Policy*  
20 2014;73:607–19.  
21  
22  
23 [57] Mathieu J, Dyson M, Callaway D. Using residential electric loads for fast demand response: The  
24 potential resource and revenues, the costs, and policy recommendations. *Proc. ACEEE Summer*  
25 *Study Energy Effic. Build.*, Pacific Grove, CA: 2012.  
26  
27 [58] Oldewurtel F, Borsche T, Bucher M, Fortenbacher P, Gonz M, Haring T, et al. A Framework for  
28 and Assessment of Demand Response and Energy Storage in Power Systems. 2013 IREP Symp.  
29 *Power Syst. Dyn. Control -IX*, Rethymnon, Greece: 2013.  
30  
31  
32 [59] Pihala H, Farin J, Kärkkäinen S. Sähkö- kysyntäjoustopotentiaalikartoitus teollisuudessa. 2005.  
33  
34 [60] Bröckl M, Vehviläinen I, Virtanen E, Keppo J. Examining and proposing measures to activate  
35 demand flexibility on the Nordic wholesale electricity market. 2011.  
36  
37  
38 [61] Arteconi A, Hewitt NJ, Polonara F. State of the art of thermal storage for demand-side  
39 management. *Appl Energy* 2012;93:371–89.  
40  
41 [62] Braun JE. Load Control Using Building Thermal Mass. *J Sol Energy Eng* 2003;125:292.  
42  
43 [63] Stadler I. Nichtelektrische Speicher für Elektrizitätsversorgungssysteme mit hohem Anteil  
44 erneuerbarer Energien. 2006.  
45  
46  
47 [64] Stadler I. Power grid balancing of energy systems with high renewable energy penetration by  
48 demand response. *Util Policy* 2008;16:90–8.  
49  
50  
51 [65] Cludius J, Hermann H, Matthes FC. The Merit Order Effect of Wind and Photovoltaic Electricity  
52 Generation in Germany 2008-2012. 2013.  
53  
54 [66] Kleimaier M. Energiespeicher in Stromversorgungssystemen mit hohem Anteil erneuerbarer  
55 Energieträger. VDE 2009.  
56  
57

- 1  
2  
3  
4 <http://www.vde.com/de/fg/ETG/Arbeitsgebiete/V1/Aktuelles/Oeffentlich/Seiten/Energiespeicherstudie-Ergebnisse.aspx> Accessed: 16/4/14  
5  
6  
7  
8 [67] Schaber K, Steinke F, Hamacher T. Transmission grid extensions for the integration of variable  
9 renewable energies in Europe: Who benefits where? *Energy Policy* 2012;43:123–35.  
10  
11 [68] Klimstra J, Hotakainen M. *Smart Power Generation*. 4th ed. Helsinki, Finland: Avain Publishers;  
12 2011.  
13  
14 [69] Evens C, Kärkkäinen S, Pihala H. *Distributed resources at customers' premises*. 2010.  
15  
16 [70] Elinkeinoelämän keskusliitto EK, Energiateollisuus ry. *Arvio Suomen sähkön kysynnästä vuonna*  
17 *2030*. 2009.  
18  
19 [71] Suomen Lämpöpumppuyhdistys ry. *Lämpöpumppua kasvoi rakentamisen alamäestä huolimatta*  
20 *ja määrä ylitti jo 600.000*. [http://www.sulpu.fi/uutiset/-](http://www.sulpu.fi/uutiset/-/asset_publisher/WD1ExS3CMra3/content/lampopumppua-kasvoi-rakentamisen-alamasta-huolimatta-ja-maara-ylitti-jo-600-000)  
21 [/asset\\_publisher/WD1ExS3CMra3/content/lampopumppua-kasvoi-rakentamisen-alamasta-](http://www.sulpu.fi/uutiset/-/asset_publisher/WD1ExS3CMra3/content/lampopumppua-kasvoi-rakentamisen-alamasta-huolimatta-ja-maara-ylitti-jo-600-000)  
22 [huolimatta-ja-maara-ylitti-jo-600-000](http://www.sulpu.fi/uutiset/-/asset_publisher/WD1ExS3CMra3/content/lampopumppua-kasvoi-rakentamisen-alamasta-huolimatta-ja-maara-ylitti-jo-600-000) Accessed: 17/11/14  
23  
24  
25 [72] Nordel. *Demand Response in the Nordic Countries: A background survey*. 2004.  
26  
27 [73] IEA. *Key World Energy Statistics*. 2014.  
28  
29 [74] Energiateollisuus ry. *Sähkön käyttö ja verkostohäviöt*. 2014. [http://energia.fi/tilastot-ja-](http://energia.fi/tilastot-ja-julkaisut/sahkotilastot/sahkonkulutus/sahkon-kaytto-ja-verkostohaviot)  
30 [julkaisut/sahkotilastot/sahkonkulutus/sahkon-kaytto-ja-verkostohaviot](http://energia.fi/tilastot-ja-julkaisut/sahkotilastot/sahkonkulutus/sahkon-kaytto-ja-verkostohaviot) Accessed: 24/9/14  
31  
32  
33 [75] Eurostat. *Energy balance sheets 2010-2011*. 2013.  
34  
35 [76] Koponen P, Kärkkäinen S, Farin J, Pihala H. *Markkinahintasignaaleihin perustuva pienkuluttajien*  
36 *sähkönkäytön ohjaus*. 2006.  
37  
38 [77] Gutschi C, Stigler H. *Potenziale und Hemmnisse für Power Demand Side Management in*  
39 *Österreich*. 10. Symp. *Energieinnovation*, 2008.  
40  
41 [78] North American Electric Reliability Corporation. *Potential Reliability Impacts of Emerging*  
42 *Flexible Resources*. 2010.  
43  
44 [79] Heffner G, Goldman C, Kirby B, Kintner-Meyer M. *Loads providing ancillary services: Review of*  
45 *international experience*. 2007.  
46  
47 [80] U.S. Energy Information Administration. *Electric Power Annual 2012*. 2013.  
48 <http://www.eia.gov/electricity/annual> Accessed: 18/8/14  
49  
50  
51 [81] Cappers P, Goldman C, Kathan D. *Demand response in U.S. electricity markets: Empirical*  
52 *evidence*. *Energy* 2010;35:1526–35.  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [82] Fenrick SA, Getachew L, Ivanov C, Smith J. Demand Impact of a Critical Peak Pricing Program:  
5 Opt-in and Opt-out Options, Green Attitudes and Other Customer Characteristics. *Energy J*  
6 2014;35.  
7  
8  
9 [83] Räsänen M, Ruusunen J, Hämäläinen RP. Identification of consumers' price responses in the  
10 dynamic pricing of electricity. *Syst. Man Cybern.* 1995. *Intell. Syst. 21st Century.*, IEEE Int.  
11 Conf., Vancouver, BC: 1995, p. 1182–7.  
12  
13 [84] Räsänen M, Ruusunen J, Hämäläinen R. Customer level analysis of dynamic pricing experiments  
14 using consumption-pattern models. *Energy* 1995;20:897–906.  
15  
16 [85] Koponen P. Measurements and models of electricity demand responses. 2012.  
17  
18 [86] Middelberg A, Zhang J, Xia X. An optimal control model for load shifting – With application in  
19 the energy management of a colliery. *Appl Energy* 2009;86:1266–73.  
20  
21 [87] Ashok S, Banerjee R. Load-management applications for the industrial sector. *Appl Energy*  
22 2000;66:105–11.  
23  
24 [88] Ashok S. Peak-load management in steel plants. *Appl Energy* 2006;83:413–24.  
25  
26 [89] Mitra S, Grossmann IE, Pinto JM, Arora N. Optimal production planning under time-sensitive  
27 electricity prices for continuous power-intensive processes. *Comput Chem Eng* 2012;38:171–84.  
28  
29 [90] Nilsson K, Söderström M. Industrial applications of production planning with optimal electricity  
30 demand. *Appl Energy* 1993;46:181–92.  
31  
32 [91] Ali M, Jokisalo J, Siren K, Lehtonen M. Combining the Demand Response of direct electric space  
33 heating and partial thermal storage using LP optimization. *Electr Power Syst Res* 2014;106:160–7.  
34  
35 [92] Van Staden AJ, Zhang J, Xia X. A model predictive control strategy for load shifting in a water  
36 pumping scheme with maximum demand charges. *Appl Energy* 2011;88:4785–94.  
37  
38 [93] Paatero JV, Lund PD. A model for generating household electricity load profiles. *Int J Energy Res*  
39 2006;30:273–90.  
40  
41 [94] Paatero J. Computational Studies of Variable Distributed Energy Systems. Helsinki University of  
42 Technology, 2009.  
43  
44 [95] Cao S, Hasan A, Sirén K. Analysis and solution for renewable energy load matching for a single-  
45 family house. *Energy Build* 2013;65:398–411.  
46  
47 [96] Finn P, O'Connell M, Fitzpatrick C. Demand side management of a domestic dishwasher: Wind  
48 energy gains, financial savings and peak-time load reduction. *Appl Energy* 2013;101:678–85.  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [97] Zong Y, Mihet-Popa L, Kullmann D, Thavlov A, Gehrke O, Bindner HW. Model Predictive  
5 Controller for Active Demand Side Management with PV self-consumption in an intelligent  
6 building. 2012 3rd IEEE PES Innov Smart Grid Technol Eur, 2012, p. 1–8.  
7  
8  
9 [98] Pedrasa MAA, Spooner TD, MacGill IF. A novel energy service model and optimal scheduling  
10 algorithm for residential distributed energy resources. *Electr Power Syst Res* 2011;81:2155–63.  
11  
12 [99] Dang T, Ringland K. Optimal load scheduling for residential renewable energy integration. 2012  
13 IEEE Third Int. Conf. Smart Grid Commun., 2012, p. 516–21.  
14  
15  
16 [100] Kennedy J, Fox B, Flynn D. Use of electricity price to match heat load with wind power  
17 generation. *Int. Conf. Sustain. Power Gener. Supply*, 2009, p. 1–6.  
18  
19 [101] Widén J. Improved photovoltaic self-consumption with appliance scheduling in 200 single-family  
20 buildings. *Appl Energy* 2014;126:199–212.  
21  
22  
23 [102] Masa-Bote D, Castillo-Cagigal M, Matallanas E, Caamaño-Martín E, Gutiérrez A, Monasterio-  
24 Huelín F, et al. Improving photovoltaics grid integration through short time forecasting and self-  
25 consumption. *Appl Energy* 2014;125:103–13.  
26  
27 [103] Lujano-Rojas JM, Monteiro C, Dufo-López R, Bernal-Agustín JL. Optimum load management  
28 strategy for wind/diesel/battery hybrid power systems. *Renew Energy* 2012;44:288–95.  
29  
30  
31 [104] Lujano-Rojas JM, Monteiro C, Dufo-López R, Bernal-Agustín JL. Optimum residential load  
32 management strategy for real time pricing (RTP) demand response programs. *Energy Policy*  
33 2012;45:671–9.  
34  
35  
36 [105] Gudi N, Wang L, Devabhaktuni V. A demand side management based simulation platform  
37 incorporating heuristic optimization for management of household appliances. *Int J Electr Power*  
38 *Energy Syst* 2012;43:185–93.  
39  
40 [106] Igualada L, Corchero C, Cruz-Zambrano M, Heredia F-J. Optimal energy management for a  
41 residential microgrid including a vehicle-to-grid system. *IEEE Trans Smart G* 2014;5:2163–72.  
42  
43 [107] Comodi G, Giantomassi A, Severini M, Squartini S, Ferracuti F, Fonti A, et al. Multi-apartment  
44 residential microgrid with electrical and thermal storage devices: Experimental analysis and  
45 simulation of energy management strategies. *Appl Energy* 2014. In press.  
46 <http://dx.doi.org/10.1016/j.apenergy.2014.07.068>  
47  
48  
49 [108] Tanaka K, Yoza A, Ogimi K, Yona A, Senjyu T, Funabashi T, et al. Optimal operation of DC  
50 smart house system by controllable loads based on smart grid topology. *Renew Energy*  
51 2012;39:132–9.  
52  
53  
54 [109] Zhang D, Papageorgiou L. Optimal scheduling of smart homes energy consumption with  
55 microgrid. *ENERGY 2011 First Int. Conf. Smart Grids, Green Commun. IT Energy-aware*  
56 *Technol.*, 2011, p. 70–5.  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [110] Marzband M, Ghadimi M, Sumper A, Domínguez-García JL. Experimental validation of a real-  
5 time energy management system using multi-period gravitational search algorithm for microgrids  
6 in islanded mode. *Appl Energy* 2014;128:164–74.  
7  
8  
9 [111] Wu C, Mohsenian-rad H, Huang J, Wang AY. Demand Side Management for Wind Power  
10 Integration in Microgrid Using Dynamic Potential Game Theory. *IEEE Int. Work. Smart Grid*  
11 *Commun Networks Demand*, 2011, p. 1199–204.  
12  
13 [112] Hashim H, Ho WS, Lim JS, Macchietto S. Integrated biomass and solar town: Incorporation of  
14 load shifting and energy storage. *Energy* 2014;75:31–9.  
15  
16 [113] Wang D, Ge S, Jia H, Wang C, Zhou Y, Lu N, et al. A Demand Response and Battery Storage  
17 Coordination Algorithm for Providing Microgrid Tie-Line Smoothing Services. *IEEE Trans*  
18 *Sustain Energy* 2014;5:476–86.  
19  
20 [114] Finn P, Fitzpatrick C. Demand side management of industrial electricity consumption: Promoting  
21 the use of renewable energy through real-time pricing. *Appl Energy* 2014;113:11–21.  
22  
23 [115] Montuori L, Alcázar-Ortega M, Álvarez-Bel C, Domijan A. Integration of renewable energy in  
24 microgrids coordinated with demand response resources: Economic evaluation of a biomass  
25 gasification plant by Homer Simulator. *Appl Energy* 2014;132:15–22.  
26  
27 [116] Zhong H, Xia Q, Xia Y, Kang C, Xie L, He W, et al. Integrated dispatch of generation and load: A  
28 pathway towards smart grids. *Electr Power Syst Res* 2014. In press.  
29 <http://dx.doi.org/10.1016/j.epsr.2014.04.005>[117] Pina A, Silva C, Ferrão P. The impact of  
30 demand side management strategies in the penetration of renewable electricity. *Energy*  
31 2012;41:128–37.  
32  
33 [118] Hamidi V, Li F, Robinson F. Responsive demand in networks with high penetration of wind  
34 power. 2008 IEEE/PES Transm. Distrib. Conf. Expo., 2008, p. 1–7.  
35  
36 [119] Niemi R, Lund PD. Alternative ways for voltage control in smart grids with distributed electricity  
37 generation. *Int J Energy Res* 2012:1032–43.  
38  
39 [120] Short J, Infield D, Freris L. Stabilization of grid frequency through dynamic demand control. *IEEE*  
40 *Trans Power Syst* 2007;22:1284–93.  
41  
42 [121] Warmer CJ, Hommelberg MPF, Kamphuis IG, Derzsi Z, Kok JK. Wind Turbines and Heat Pumps  
43 - Balancing wind power fluctuations using flexible demand. 6th Int. Work. Large-Scale Integr.  
44 *Wind Power Transm. Networks Offshore Wind Farms*, 2006, p. 1–9.  
45  
46 [122] Göransson L, Goop J, Unger T, Odenberger M, Johnsson F. Linkages between demand-side  
47 management and congestion in the European electricity transmission system. *Energy*  
48 2014;69:860–72.  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [123] Moura PS, de Almeida AT. The role of demand-side management in the grid integration of wind  
5 power. *Appl Energy* 2010;87:2581–8.  
6  
7 [124] De Jonghe C, Hobbs BF, Belmans R. Optimal Generation Mix With Short-Term Demand  
8 Response and Wind Penetration. *IEEE Trans Power Syst* 2012;27:830–9.  
9  
10 [125] Bruninx K, Patteeuw D, Delarue E, Helsen L, D’haeseleer W. Short-term demand response of  
11 flexible electric heating systems: the need for integrated simulations. *10th Int. Conf. Eur. Energy*  
12 *Mark.*, 2013, p. 1–10.  
13  
14 [126] Ziadi Z, Taira S, Oshiro M. Optimal Power Scheduling for Smart Grids Considering Controllable  
15 Loads and High Penetration of Photovoltaic Generation. *IEEE Trans Smart Grid* 2014;5:2350–9.  
16  
17 [127] Hu W, Chen Z, Bak-Jensen B. Impact of optimal load response to real-time electricity price on  
18 power system constraints in Denmark. *Univ. Power Eng. Conf.*, 2010, p. 1–6.  
19  
20 [128] Mahat P, Chen Z, Bak-Jensen B. Underfrequency load shedding for an islanded distribution  
21 system with distributed generators. *IEEE Trans Power Deliv* 2010;25:911–8.  
22  
23 [129] Dietrich K, Latorre JM, Olmos L, Ramos A. Demand Response in an Isolated System With High  
24 Wind Integration. *IEEE Trans Power Syst* 2012;27:20–9.  
25  
26 [130] Zakariazadeh A, Homaei O, Jadid S, Siano P. A new approach for real time voltage control using  
27 demand response in an automated distribution system. *Appl Energy* 2014;117:157–66.  
28  
29 [131] Broeer T, Fuller J, Tuffner F, Chassin D, Djilali N. Modeling framework and validation of a smart  
30 grid and demand response system for wind power integration. *Appl Energy* 2014;113:199–207.  
31  
32 [132] Papaefthymiou G, Hasche B, Nabe C. Potential of Heat Pumps for Demand Side Management and  
33 Wind Power Integration in the German Electricity Market. *IEEE Trans Sustain Energy*  
34 *2012;3:636–42.*  
35  
36 [133] Klobasa M. Analysis of demand response and wind integration in Germany’s electricity market.  
37 *IET Renew Power Gener* 2010;4:55.  
38  
39 [134] EcoGrid EU. <http://www.eu-ecogrid.net> Accessed: 23/4/14  
40  
41 [135] Gantenbein D, Binding C, Jansen B, Mishra A, Sundstr O. EcoGrid EU : An Efficient ICT  
42 Approach for a Sustainable Power System. *Sustain. Internet ICT Sustain.*, 2012.  
43  
44 [136] Kirby B. Ancillary Services: Technical and Commercial Insights. 2007.  
45  
46 [137] North American Electric Reliability Corporation. Ancillary Service and Balancing Authority Area  
47 Solutions to Integrate Variable Generation. 2011.  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65



- 1  
2  
3  
4 [138] Miller NW, Clark K, Shao M. Frequency responsive wind plant controls: Impacts on grid  
5 performance. 2011 IEEE Power Energy Soc. Gen. Meet., San Diego, California: IEEE; 2011, p. 1–  
6 8.  
7  
8  
9 [139] Lazarewicz ML, Ryan TM. Integration of flywheel-based energy storage for frequency regulation  
10 in deregulated markets. 2010 IEEE Power Energy Soc. Gen. Meet., Minneapolis, Minnesota:  
11 IEEE; 2010, p. 1–6.  
12  
13 [140] Sundararagavan S, Baker E. Evaluating energy storage technologies for wind power integration.  
14 Sol Energy 2012;86:2707–17.  
15  
16 [141] Ferreira HL, Garde R, Fulli G, Kling W, Lopes JP. Characterisation of electrical energy storage  
17 technologies. Energy 2013;53:288–98.  
18  
19 [142] Hebner R, Beno J, Walls A. Flywheel batteries come around again. IEEE Spectr 2002;39:46–51.  
20  
21 [143] Li W, Joós G. Comparison of Energy Storage System Technologies and Configurations in a Wind  
22 Farm. Power Electron. Spec. Conf., Orlando, Florida: IEEE; 2007, p. 1280–5.  
23  
24 [144] Rabiee A, Khorramdel H, Aghaei J. A review of energy storage systems in microgrids with wind  
25 turbines. Renew Sustain Energy Rev 2013;18:316–26.  
26  
27 [145] Kondoh J, Ishii I, Yamaguchi H, Murata a., Otani K, Sakuta K, et al. Electrical energy storage  
28 systems for energy networks. Energy Convers Manag 2000;41:1863–74.  
29  
30 [146] Breeze P. Power Generation Technologies. 1st ed. Elsevier Science; 2005.  
31  
32 [147] Makarov YV, Yang G, DeSteele JG, Lu S, Miller CH, Nyeng P, et al. Wide-Area Energy Storage  
33 and Management System to Balance Intermittent Resources in the Bonneville Power  
34 Administration and California ISO Control Areas. 2008.  
35  
36 [148] Kondoh J, Lu N, Hammerstrom DJ. An evaluation of the water heater load potential for providing  
37 regulation service. IEEE PES Gen. Meet., 2011.  
38  
39 [149] Fingrid. System Reserves.  
40 <http://www.fingrid.fi/en/powersystem/reserves/system%20reserves/Pages/default.aspx> Accessed:  
41 31/10/13  
42  
43 [150] Denholm P, Ela E, Kirby B, Milligan M. The Role of energy storage with renewable electricity  
44 generation. Golden, Colorado: 2010.  
45  
46 [151] Deane JP, Ó Gallachóir BP, McKeogh EJ. Techno-economic review of existing and new pumped  
47 hydro energy storage plant. Renew Sustain Energy Rev 2010;14:1293–302.  
48  
49 [152] Bullough C, Gatzert C, Jakiel C, Koller M, Nowi A, Zunft S. Advanced Adiabatic Compressed Air  
50 Energy Storage for the Integration of Wind Energy. Proc. Eur. Wind Energy Conf., 2004, p. 22–5.  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [153] Akhil AA, Huff G, Currier AB, Kaun BC, Rastler DM, Chen SB, et al. DOE/EPRI 2013  
5 Electricity Storage Handbook in Collaboration with NRECA. Albuquerque, New Mexico: 2013.  
6  
7  
8 [154] Sullivan P, Short W, Blair N. Modeling the Benefits of Storage Technologies to Wind Power. Am.  
9 Wind Energy Assoc. Wind., 2008, p. 603–15.  
10  
11 [155] Drury E, Denholm P, Sioshansi R. The value of compressed air energy storage in energy and  
12 reserve markets. Energy 2011;36:4959–73.  
13  
14 [156] Tuohy A, O’Malley M. Wind Power and Storage. In: Wind Power in Power Systems. 2nd ed.,  
15 West Sussex, United Kingdom: Wiley; 2012, p. 465–87.  
16  
17  
18 [157] Parkinson S, Wang D, Djilali N. Toward low carbon energy systems: The convergence of wind  
19 power, demand response, and the electricity grid. Innov Smart Grid Technol. - Asia (ISGT Asia),  
20 2012 IEEE, 2012, p. 1–8.  
21  
22 [158] Cavallo A. Controllable and affordable utility-scale electricity from intermittent wind resources  
23 and compressed air energy storage (CAES). Energy 2007;32:120–7.  
24  
25 [159] Hadjipaschalis I, Poullikkas A, Efthimiou V. Overview of current and future energy storage  
26 technologies for electric power applications. Renew Sustain Energy Rev 2009;13:1513–22.  
27  
28 [160] Ummels BC, Pelgrum E, Kling WL. Integration of large-scale wind power and use of energy  
29 storage in the Netherlands’ electricity supply. IET Renew Power Gener 2008;2:34.  
30  
31 [161] American Electric Power. Renewables.  
32 <http://www.aep.com/about/IssuesAndPositions/Transmission/Renewables.aspx> Accessed:  
33 17/11/2014.  
34  
35 [162] Vartabedian R. Rise in renewable energy will require more use of fossil fuels. Los Angeles Times.  
36 <http://articles.latimes.com/2012/dec/09/local/la-me-unreliable-power-20121210> Accessed:  
37 17/11/2014  
38  
39 [163] Lea R. Electricity Costs: The folly of wind- power. London, England: 2012.  
40  
41  
42 [164] Rastler D. New demand for energy storage. Electr Perspect 2008:30–47.  
43  
44 [165] Denholm P, Margolis RM. Evaluating the limits of solar photovoltaics (PV) in electric power  
45 systems utilizing energy storage and other enabling technologies. Energy Policy 2007;35:4424–33.  
46  
47 [166] Nyamdash B, Denny E, O’Malley M. The viability of balancing wind generation with large scale  
48 energy storage. Energy Policy 2010;38:7200–8.  
49  
50 [167] González A, McKeogh E, Gallachóir BÓÓ. The role of hydrogen in high wind energy penetration  
51 electricity systems: The Irish case. Renew Energy 2004;29:471–89.  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [168] Yang C-J, Jackson RB. Opportunities and barriers to pumped-hydro energy storage in the United  
5 States. *Renew Sustain Energy Rev* 2011;15:839–44.  
6  
7  
8 [169] International Energy Agency. *Hydropower Good Practices: Environmental Mitigation Measures*  
9 *and Benefits*. 2006.  
10  
11 [170] Australian National University. *Pumped Hydro Storage*. 2012.  
12  
13 [171] Dell RM, Rand DAJ. Energy storage — a key technology for global energy sustainability. *J Power*  
14 *Sources* 2001;100:2–17.  
15  
16  
17 [172] Electricity Storage Association. *Pumped Hydro*. 2012.  
18  
19 [173] Steward D, Saur G, Penev M, Ramsden T. *Lifecycle Cost Analysis of Hydrogen Versus Other*  
20 *Technologies for Electrical Energy Storage*. 2009.  
21  
22 [174] Kaldellis JK, Zafirakis D. Optimum energy storage techniques for the improvement of renewable  
23 energy sources-based electricity generation economic efficiency. *Energy* 2007;32:2295–305.  
24  
25 [175] Ackermann T. *Wind Power in Power Systems*. 2nd ed. West Sussex, United Kingdom: Wiley;  
26 2012.  
27  
28 [176] Jaramillo OA, Borja MA, Huacuz JM. Using hydropower to complement wind energy: a hybrid  
29 system to provide firm power. *Renew Energy* 2004;29:1887–909.  
30  
31 [177] Dursun B, Alboyaci B, Gokcol C. Optimal wind-hydro solution for the Marmara region of Turkey  
32 to meet electricity demand. *Energy* 2011;36:864–72.  
33  
34 [178] Kaldellis JK, Kavadias KA. Optimal wind-hydro solution for Aegean Sea islands' electricity-  
35 demand fulfilment. *Appl Energy* 2001;70:333–54.  
36  
37 [179] Gottlieb Paludan Architects, Green Power Island.  
38 <http://www.gottliebpaludan.com/en/project/green-power-island> Accessed: 17/11/2014  
39  
40 [180] MIT News. Wind power - even without the wind. [http://newsoffice.mit.edu/2013/wind-power-](http://newsoffice.mit.edu/2013/wind-power-even-without-the-wind-0425)  
41 [even-without-the-wind-0425](http://newsoffice.mit.edu/2013/wind-power-even-without-the-wind-0425) Accessed: 17/11/2014  
42  
43 [181] Gravity Power. <http://www.gravitypower.net> Accessed: 17/11/2014  
44  
45 [182] Ares North America. *Grid Scale Energy Storage*. [http://www.aresnorthamerica.com/grid-scale-](http://www.aresnorthamerica.com/grid-scale-energy-storage)  
46 [energy-storage](http://www.aresnorthamerica.com/grid-scale-energy-storage) Accessed: 17/11/2014  
47  
48 [183] Pimm AJ, Garvey SD, Drew RJ. Shape and cost analysis of pressurized fabric structures for  
49 subsea compressed air energy storage. *Proc Inst Mech Eng Part C J Mech Eng Sci*  
50 2011;225:1027–43.  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [184] Electric Power Research Institute. Comparison of Storage Technologies for Distributed Resource  
5 Applications. 2003.  
6  
7  
8 [185] Gardner J, Haynes T. Overview of Compressed Air Energy Storage. 2007.  
9  
10 [186] Maton J-P, Zhao L, Brouwer J. Dynamic modeling of compressed gas energy storage  
11 to complement renewable wind power intermittency. *Int J Hydrogen Energy* 2013;38:7867–80.  
12  
13 [187] Elmegaard B, Brix W. Efficiency of Compressed Air Energy Storage. 24th Int. Conf. Effic. Cost,  
14 Optim. Simul. Environ. Impact Energy Syst., 2011.  
15  
16 [188] Greenblatt JB, Succar S, Denkenberger DC, Williams RH, Socolow RH. Baseload wind energy:  
17 modeling the competition between gas turbines and compressed air energy storage for  
18 supplemental generation. *Energy Policy* 2007;35:1474–92.  
19  
20 [189] Khaitan SK, Raju M. Dynamics of hydrogen powered CAES based gas turbine plant using sodium  
21 alanate storage system. *Int J Hydrogen Energy* 2012;37:18904–14.  
22  
23 [190] Denholm P. Improving the technical, environmental and social performance of wind energy  
24 systems using biomass-based energy storage. *Renew Energy* 2006;31:1355–70.  
25  
26 [191] Mauch B, Carvalho PMS, Apt J. Can a wind farm with CAES survive in the day-ahead market?  
27 *Energy Policy* 2012;48:584–93.  
28  
29 [192] Lund H, Salgi G. The role of compressed air energy storage (CAES) in future sustainable energy  
30 systems. *Energy Convers Manag* 2009;50:1172–9.  
31  
32 [193] Swider DJ. Compressed Air Energy Storage in an Electricity System With Significant Wind  
33 Power Generation. *IEEE Trans Energy Convers* 2007;22:95–102.  
34  
35 [194] Electric Power Research Institute, U.S. Department of Energy. EPRI-DOE Handbook of Energy  
36 Storage for Transmission & Distribution Applications. Palo Alto, CA and Washington, DC: 2003.  
37  
38 [195] Hasan NS, Hassan MY, Majid MS, Rahman HA. Mathematical Model of Compressed Air Energy  
39 Storage in Smoothing 2MW Wind Turbine. *Power Eng. Optim. Conf.*, 2012, p. 339–43.  
40  
41 [196] Salgi G, Lund H. System behaviour of compressed-air energy-storage in Denmark with a high  
42 penetration of renewable energy sources. *Appl Energy* 2008;85:182–9.  
43  
44 [197] Kauranen PS, Lund PD, Vanhanen JP. Development of a self-sufficient solar-hydrogen energy  
45 system. *Int J Energy Res* 1994;19:99–106.  
46  
47 [198] Kapdan IK, Kargi F. Bio-hydrogen production from waste materials. *Enzyme Microb Technol*  
48 2006;38:569–82.  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [199] Hasan NS, Hassan MY, Majid MS, Rahman HA. Review of storage schemes for wind energy  
5 systems. *Renew Sustain Energy Rev* 2013;21:237–47.  
6  
7  
8 [200] Wit MP De, Faaij APC. Impact of hydrogen onboard storage technologies on the performance of  
9 hydrogen fuelled vehicles : A techno-economic well-to-wheel assessment. *Int J Hydrogen Energy*  
10 2007;32:4859–70.  
11  
12 [201] Lovins AB. *Twenty Hydrogen Myths*. 2005.  
13  
14 [202] Balat M. Potential importance of hydrogen as a future solution to environmental and transportation  
15 problems. *Int J Hydrogen Energy* 2008;33:4013–29.  
16  
17  
18 [203] Hagström M, Lund PD, Vanhanen JP. Metal hydride hydrogen storage for near-ambient  
19 temperature and atmospheric pressure applications, a PDSC study. *Int J Hydrogen Energy*  
20 1995;20:897–909.  
21  
22 [204] Ozbilen A, Dincer I, Naterer GF, Aydin M. Role of hydrogen storage in renewable energy  
23 management for Ontario. *Int J Hydrogen Energy* 2012;37:7343–54.  
24  
25 [205] Vanhanen JP, Kauranen PS, Lund PD, Manninen LM. Simulation of solar hydrogen energy  
26 systems. *Sol Energy* 1994;53:267–78.  
27  
28 [206] Gammon R, Roy A, Barton J, Little M. *Hydrogen and Renewables Integration (HARI)*.  
29 Loughborough, UK: 2006.  
30  
31  
32 [207] Gutiérrez-Martín F, Confente D, Guerra I. Management of variable electricity loads in wind –  
33 Hydrogen systems: The case of a Spanish wind farm. *Int J Hydrogen Energy* 2010;35:7329–36.  
34  
35 [208] Nakken T, Strand LR, Frantzen E, Rohden R, Eide PO. The Utsira wind-hydrogen system -  
36 operational experience. *Proc. Eur. Wind Energy Conf. Exhib.*, 2006.  
37  
38 [209] Ulleberg Ø, Nakken T, Eté A. The wind/hydrogen demonstration system at Utsira in Norway:  
39 Evaluation of system performance using operational data and updated hydrogen energy system  
40 modeling tools. *Int J Hydrogen Energy* 2010;35:1841–52.  
41  
42 [210] Gazey R, Salman SK, Aklil-D'Halluin DD. A field application experience of integrating hydrogen  
43 technology with wind power in a remote island location. *J Power Sources* 2006;157:841–7.  
44  
45 [211] Ghosh PC, Emonts B, Janßen H, Mergel J, Stolten D. Ten years of operational experience with a  
46 hydrogen-based renewable energy supply system. *Sol Energy* 2003;75:469–78.  
47  
48 [212] Sherif SA, Barbir F, Veziroglu TN. Towards a Hydrogen Economy. *Electr J* 2005;18:62–76.  
49  
50 [213] Bossel U. Does a Hydrogen Economy Make Sense? *Proc IEEE* 2006;94:1826–37.  
51  
52 [214] Hammerschlag R, Mazza P. Questioning hydrogen. *Energy Policy* 2005;33:2039–43.  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [215] Converse AO. The impact of large-scale energy storage requirements on the choice between  
5 electricity and hydrogen as the major energy carrier in a non-fossil renewables-only scenario.  
6 Energy Policy 2006;34:3374–6.  
7  
8  
9 [216] Tønnesen AE, Pedersen AHAS, Nielsen AH, Knöpfli A, Elmegaard B, Rasmussen J, et al.  
10 Electricity Storage Technologies for Short Term Power System Services at Transmission Level.  
11 2010.  
12  
13 [217] Poonpun P, Jewell WT. Analysis of the Cost per Kilowatt Hour to Store Electricity. IEEE Trans  
14 Energy Convers 2008;23:529–34.  
15  
16 [218] Clean Energy Action Project. Rokkasho-Futamata Wind Farm.  
17 [http://www.cleanenergyactionproject.com/CleanEnergyActionProject/CS.Rokkasho-](http://www.cleanenergyactionproject.com/CleanEnergyActionProject/CS.Rokkasho-Futamata_Wind_Farm___Energy_Storage_Case_Study.html)  
18 [Futamata\\_Wind\\_Farm\\_\\_\\_Energy\\_Storage\\_Case\\_Study.html](http://www.cleanenergyactionproject.com/CleanEnergyActionProject/CS.Rokkasho-Futamata_Wind_Farm___Energy_Storage_Case_Study.html) Accessed: 17/11/2014  
19  
20 [219] Riffonneau Y, Bacha S, Barruel F, Ploix S. Optimal Power Flow Management for Grid Connected  
21 PV Systems With Batteries. IEEE Trans Sustain Energy 2011;2:309–20.  
22  
23 [220] Bragard M, Soltau N, Thomas S, De Doncker RW. The Balance of Renewable Sources and User  
24 Demands in Grids: Power Electronics for Modular Battery Energy Storage Systems. IEEE Trans  
25 Power Electron 2010;25:3049–56.  
26  
27 [221] Teleke S, Baran ME, Bhattacharya S, Huang AQ. Rule-Based Control of Battery Energy Storage  
28 for Dispatching Intermittent Renewable Sources. IEEE Trans Sustain Energy 2010;1:117–24.  
29  
30 [222] Reddy TB, Linden D. Linden’s Handbook of Batteries. 4th ed. New York: McGraw-Hill; 2011.  
31  
32 [223] Lowry J, Larminie J. Electric Vehicle Technology Explained. 2nd ed. Somerset, New Jersey:  
33 Wiley; 2012.  
34  
35 [224] Woodbank Communications. Cell chemistry comparison chart.  
36 [www.mpoweruk.com/specifications/comparisons.pdf](http://www.mpoweruk.com/specifications/comparisons.pdf) Accessed: 17/11/2014  
37  
38 [225] Hall PJ, Bain EJ. Energy-storage technologies and electricity generation. Energy Policy  
39 2008;36:4352–5.  
40  
41 [226] Prudent Energy. Prudent Energy Announces Megawatt-Class Energy Storage Project with Major  
42 Food Processing Company in California 2010.  
43  
44 [227] Banham-Hall DD, Taylor GA, Smith CA, Irving MR. Flow Batteries for Enhancing Wind Power  
45 Integration. IEEE Trans Power Syst 2012;27:1690–7.  
46  
47 [228] Wang W, Ge B, Bi D, Sun D. Grid-connected wind farm power control using VRB-based energy  
48 storage system. 2010 IEEE Energy Convers Congr Expo 2010:3772–7.  
49  
50 [229] Cadex Electronics. Battery University. <http://batteryuniversity.com> Accessed: 17/11/2014  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [230] McCluer S, Christin J. Comparing Data Center Batteries, Flywheels, and Ultracapacitors. 2011.  
5  
6 [231] Chen H, Cong TN, Yang W, Tan C, Li Y, Ding Y. Progress in electrical energy storage system: A  
7 critical review. Prog Nat Sci 2009;19:291–312.  
8  
9 [232] Rydh CJ, Sandén B a. Energy analysis of batteries in photovoltaic systems. Part I: Performance  
10 and energy requirements. Energy Convers Manag 2005;46:1957–79.  
11  
12 [233] Tarascon JM, Armand M. Issues and challenges facing rechargeable lithium batteries. Nature  
13 2001;414:359–67.  
14  
15 [234] Chen JC. Rechargeable Batteries. Phys. Sol. Energy. 1st ed., Hoboken, New Jersey: Wiley; 2011,  
16 p. 262–9.  
17  
18 [235] Häberlin H. PV System Batteries. Photovoltaics Syst. Des. Pract. 1st ed., Hoboken, New Jersey:  
19 Wiley; 2012, p. 225–42.  
20  
21 [236] Barton JP, Infield DG. Energy Storage and Its Use With Intermittent Renewable Energy. IEEE  
22 Trans Energy Convers 2004;19:441–8.  
23  
24 [237] PowerStream Technology. NiMH Battery Charging Basics.  
25 <http://www.powerstream.com/NiMH.htm> Accessed: 17/11/2014  
26  
27 [238] Kazempour SJ, Moghaddam MP, Haghifam MR, Yousefi GR. Electric energy storage systems in a  
28 market-based economy: Comparison of emerging and traditional technologies. Renew Energy  
29 2009;34:2630–9.  
30  
31 [239] Sudworth J. The sodium/nickel chloride (ZEBRA) battery. J Power Sources 2001;100:149–63.  
32  
33 [240] Dustmann C-H. Advances in ZEBRA batteries. J Power Sources 2004;127:85–92.  
34  
35 [241] Galloway RC, Dustmann CH. ZEBRA Battery - Material Cost Availability and Recycling. EVS-  
36 20, Long Beach, California: 2003, p. 1–9.  
37  
38 [242] Galloway RC, Haslam S. The ZEBRA electric vehicle battery: power and energy improvements. J  
39 Power Sources 1999;80:164–70.  
40  
41 [243] Meridian International Research. The Sodium Nickel Chloride “Zebra” Battery 2005:104–12.  
42  
43 [244] Liu H, Jiang J. Flywheel energy storage—An upswing technology for energy sustainability.  
44 Energy Build 2007;39:599–604.  
45  
46 [245] Kohari Z, Vajda I. Losses of flywheel energy storages and joint operation with solar cells. J Mater  
47 Process Technol 2005;161:62–5.  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [246] Review of the Research Program of the Partnership for a New Generation of Vehicles: Second  
5 Report. Washington, DC: The National Academies Press; 1996.  
6  
7  
8 [247] Saudemont C, Cimuca G, Robyns B, Radulescu MM. Grid connected or stand-alone real-time  
9 variable speed wind generator emulator associated to a flywheel energy storage system. 2005 Eur.  
10 Conf. Power Electron. Appl., 2005.  
11  
12 [248] Cimuca GO, Saudemont C, Robyns B, Radulescu MM. Control and Performance Evaluation of a  
13 Flywheel Energy-Storage System Associated to a Variable-Speed Wind Generator. IEEE Trans  
14 Ind Electron 2006;53:1074–85.  
15  
16 [249] Takahashi R, Murata T, Tamura J. An Application of Flywheel Energy Storage System for Wind  
17 Energy Conversion. 2005 Int. Conf. Power Electron. Drives Syst., 2005, p. 932–7.  
18  
19  
20 [250] American Physical Society. Challenges of Electricity Storage Technologies. 2007.  
21  
22 [251] Molina MG, Mercado PE. Power Flow Stabilization and Control of Microgrid with Wind  
23 Generation by Superconducting Magnetic Energy Storage. IEEE Trans Power Electron  
24 2011;26:910–22.  
25  
26 [252] Simon P, Gogotsi Y. Materials for electrochemical capacitors. Nat Mater 2008;7:845–54.  
27  
28 [253] Kinjo T, Senjyu T, Urasaki N, Fujita H. Output Levelling of Renewable Energy by Electric  
29 Double-Layer Capacitor Applied for Energy Storage System. IEEE Trans Energy Convers  
30 2006;21:221–7.  
31  
32  
33 [254] Abedini A, Nasiri A. Applications of super capacitors for PMSG wind turbine power smoothing.  
34 Proc. 34th Annu. Conf. IEEE Ind. Electron., Orlando, Florida: IEEE; 2008, p. 3347–51.  
35  
36 [255] Li W, Joós G, Bélanger J. Real-Time Simulation of a Wind Turbine Generator Coupled With a  
37 Battery Supercapacitor Energy Storage System. IEEE Trans Ind Electron 2010;57:1137–45.  
38  
39 [256] Glavin ME, Hurley WG. Ultracapacitor/ battery hybrid for solar energy storage. Proc. 42nd Int.  
40 Univ. Power Eng. Conf., 2007, p. 791–5.  
41  
42 [257] Fink S, Mudd C, Porter K, Morgenstern B. Wind Energy Curtailment Case Studies May 2008 —  
43 May 2009. 2009.  
44  
45 [258] Riesz J, Milligan M. Designing electricity markets for a high penetration of variable renewables.  
46 Wiley Interdiscip Rev Energy Environ 2014.  
47  
48 [259] De Brabandere K, Woyte A, Belmans R, Nijs J. Prevention of inverter voltage tripping in high  
49 density PV grids. Proc. 19th Eur. Photovolt. Sol. Energy Conf., 2004, p. 4–7.  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65



- 1  
2  
3  
4 [260] Tonkoski R, Lopes LAC. Impact of active power curtailment on overvoltage prevention and  
5 energy production of PV inverters connected to low voltage residential feeders. *Renew Energy*  
6 2011;36:3566–74.  
7  
8  
9 [261] Zhou Q, Bialek JW. Generation curtailment to manage voltage constraints in distribution  
10 networks. *IET Gener Transm Distrib* 2007;1:492–8.  
11  
12 [262] Yoshida K, Kouchi K, Nakanishi Y, Ota H, Yokoyama R. Centralized control of clustered PV  
13 generations for loss minimization and power quality. 2008 IEEE Power Energy Soc. Gen. Meet. -  
14 Convers. Deliv. Electr. Energy 21st Century, 2008, p. 1–6.  
15  
16 [263] Conti S, Greco A, Messina N, Raiti S. Local Voltage Regulation in LV Distribution Networks  
17 with PV Distributed Generation. *Int. Symp. Power Electron. Electr. Drives, Autom. Motion*, 2006,  
18 p. 1–6.  
19  
20 [264] Demirok E, Sera D, Teodorescu R, Rodriguez P, Borup U. Clustered PV Inverters in LV  
21 Networks : An Overview of Impacts and Comparison of Voltage Control Strategies. 2009 IEEE  
22 Electr. Power Energy Conf., 2009, p. 1–6.  
23  
24 [265] Brinkman G, Denholm P, Drury E, Margolis R, Mowers M. Toward a solar-powered grid. *IEEE*  
25 *Power Energy Mag* 2011:24–32.  
26  
27 [266] Burke DJ, O'Malley MJ. Factors Influencing Wind Energy Curtailment. *IEEE Trans Sustain*  
28 *Energy* 2011;2:185–93.  
29  
30 [267] Mc Garrigle EV, Deane JP, Leahy PG. How much wind energy will be curtailed on the 2020 Irish  
31 power system? *Renew Energy* 2013;55:544–53.  
32  
33 [268] Wehrmann A-K. Germany keeping more wind power off the grid. *New Energy* 2013.  
34 <http://www.newenergy.info/economy/companies/germany-keeping-more-wind-power-off-the-grid>  
35 Accessed: 2/10/13  
36  
37 [269] Doty FD. Guest Post: Kicking Oil Addiction With Windfuels. *Greentech Effic* 2011.  
38 [http://www.greentechmedia.com/articles/read/guest-post-kicking-oil-addiction-permanently-with-](http://www.greentechmedia.com/articles/read/guest-post-kicking-oil-addiction-permanently-with-windfuels)  
39 [windfuels](http://www.greentechmedia.com/articles/read/guest-post-kicking-oil-addiction-permanently-with-windfuels) Accessed: 2/10/13  
40  
41 [270] Srinivas T, Reddy BV. Comparative studies of augmentation in combined cycle power plants. *Int J*  
42 *Energy Res* 2014;38:1201–13.  
43  
44 [271] Eurogas. Long term outlook for gas demand and supply 2007–2030. Brussels, Belgium: 2010.  
45  
46 [272] Bass RJ, Malalasekera W, Willmot P, Versteeg HK. The impact of variable demand upon the  
47 performance of a combined cycle gas turbine (CCGT) power plant. *Energy* 2011;36:1956–65.  
48  
49 [273] Maddaloni JD, Rowe AM, van Kooten GC. Wind integration into various generation mixtures.  
50 *Renew Energy* 2009;34:807–14.  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [274] Parrilla E. Power and Gas Integration : The Spanish Experience. IEEE Power Energy Soc. Gen.  
5 Meet., 2008, p. 1–5.  
6  
7 [275] Qadrdan M, Chaudry M, Wu J, Jenkins N, Ekanayake J. Impact of a large penetration of wind  
8 generation on the GB gas network. Energy Policy 2010;38:5684–95.  
9  
10 [276] Keyaerts NR, Rombauts Y, Delarue ED, D’haeseleer WD. Impact of wind power on natural gas  
11 markets: Inter market flexibility. 2010 7th Int. Conf. Eur. Energy Mark., 2010, p. 1–6.  
12  
13 [277] Keyaerts N, Rombauts Y, Delarue E, D’haeseleer W. Impact assessment of increasing  
14 unpredictability in gas balancing caused by massive wind power integration. 2011.  
15  
16 [278] Shipley A, Hampson A, Hedman B, Garland P, Bautista P. Combined Heat and Power: Effective  
17 Energy Solutions for a Sustainable Future. 2008.  
18  
19 [279] Mago PJ, Smith AD. Methodology to estimate the economic, emissions, and energy benefits from  
20 combined heat and power systems based on system component efficiencies. Int J Energy Res  
21 2014;38:1457–66.  
22  
23 [280] Lund H. Renewable energy strategies for sustainable development. Energy 2007;32:912–9.  
24  
25 [281] Streckienė G, Martinaitis V, Andersen AN, Katz J. Feasibility of CHP-plants with thermal stores  
26 in the German spot market. Appl Energy 2009;86:2308–16.  
27  
28 [282] Lund H. Large-scale integration of wind power into different energy systems. Energy  
29 2005;30:2402–12.  
30  
31 [283] Lund H, Andersen AN, Østergaard PA, Mathiesen BV, Connolly D. From electricity smart grids  
32 to smart energy systems – A market operation based approach and understanding. Energy  
33 2012;42:96–102.  
34  
35 [284] Ahnger A, Iversen B, Frejman M. Smart Power Generation for a changing world. Energy Detail,  
36 Wärtsilä Tech J 022012 2012:4–8.  
37  
38 [285] Mago PJ, Luck R, Knizley A. Combined heat and power systems with dual power generation units  
39 and thermal storage. Int J Energy Res 2014;38:896–907.  
40  
41 [286] Lund P. Large-scale urban renewable electricity schemes – Integration and interfacing aspects.  
42 Energy Convers Manag 2012;63:162–72.  
43  
44 [287] Niemi R, Mikkola J, Lund PD. Urban energy systems with smart multi-carrier energy networks  
45 and renewable energy generation. Renew Energy 2012;48:524–36.  
46  
47 [288] Lund PD, Mikkola J, Ypyä J. Smart energy system design for large clean power schemes in urban  
48 areas. J Clean Prod 2014.  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [289] Waite M, Modi V. Potential for increased wind-generated electricity utilization using heat pumps  
5 in urban areas. *Appl Energy* 2014;135:634–642.  
6  
7  
8 [290] Meibom P, Kiviluoma J, Brand H, Weber C, Larsen H V. Value of Electric Heat Boilers and  
9 Integration 2007:321–37.  
10  
11 [291] Mathiesen BV, Lund H. Comparative analyses of seven technologies to facilitate the integration of  
12 fluctuating renewable energy sources. *IET Renew Power Gener* 2009;3:190–204.  
13  
14 [292] Zhou W. China is now using curtailed wind power to displace coal-fired heating. *REVE Wind*  
15 *Energy Electr Veh Rev* 2013. [http://www.evwind.es/2013/04/26/china-is-now-using-curtailed-](http://www.evwind.es/2013/04/26/china-is-now-using-curtailed-wind-power-to-displace-coal-fired-heating/32165)  
16 [wind-power-to-displace-coal-fired-heating/32165](http://www.evwind.es/2013/04/26/china-is-now-using-curtailed-wind-power-to-displace-coal-fired-heating/32165) Accessed: 4/10/2013  
17  
18 [293] Specht M, Baumgart F, Feigl B, Frick V, Stürmer B, Zuberbühler U, et al. Storing bioenergy and  
19 renewable electricity in the natural gas grid. *FVEE AEE Top 2009* 2009:69–78.  
20  
21 [294] Trost T, Horn S, Jentsch M, Sterner M. Erneuerbares Methan: Analyse der CO<sub>2</sub>-Potenziale für  
22 Power-to-Gas Anlagen in Deutschland. *Zeitschrift Für Energiewirtschaft* 2012;36:173–90.  
23  
24 [295] Walter MG, Warren EL, McKone JR, Boettcher SW, Mi Q, Santori EA, et al. Solar water splitting  
25 cells. *Chem Rev* 2010;110:6446–73.  
26  
27 [296] Gondal IA, Sahir MH. Prospects of natural gas pipeline infrastructure in hydrogen transportation.  
28 *Int J Energy Res* 2012;36:1338–45.  
29  
30 [297] Sherif SA, Barbir F, Veziroglu TN. Wind energy and the hydrogen economy—review of the  
31 technology. *Sol Energy* 2005;78:647–60.  
32  
33 [298] Fingersh LJ. Optimized Hydrogen and Electricity Generation from Wind Optimized Hydrogen and  
34 Electricity Generation from Wind. NREL, 2003.  
35  
36 [299] Salgi G, Donslund B, Alberg Østergaard P. Energy system analysis of utilizing hydrogen as an  
37 energy carrier for wind power in the transportation sector in Western Denmark. *Util Policy*  
38 2008;16:99–106.  
39  
40 [300] Gahleitner G. Hydrogen from renewable electricity: An international review of power-to-gas pilot  
41 plants for stationary applications. *Int J Hydrogen Energy* 2013;38:2039–61.  
42  
43 [301] Mikkola J. Modelling of smart multi-energy carrier networks for sustainable cities (Master’s  
44 thesis). Aalto University School of Science, 2012.  
45  
46 [302] Geidl M, Andersson G. Optimal Power Flow of Multiple Energy Carriers. *IEEE Trans Power Syst*  
47 2007;22:145–55.  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [303] Hajimiragha H, Canizares C, Fowler M, Geidl M, Andersson G. Optimal Energy Flow of  
5 Integrated Energy Systems with Hydrogen Economy Considerations. *Bulk Power Syst. Dyn.*  
6 *Control – VII*, 2007, p. 1–11.  
7  
8  
9 [304] Sharif A, Almansoori A, Fowler M, Elkamel A, Alrafea K. Design of an energy hub based on  
10 natural gas and renewable energy sources. *Int J Energy Res* 2014;38:363–73.  
11  
12 [305] Reinventing Parking: “Cars are parked 95% of the time”. Let’s check!  
13 <http://www.reinventingparking.org/2013/02/cars-are-parked-95-of-time-lets-check.html> Accessed:  
14 17/11/2014  
15  
16  
17 [306] Kempton W, Udo V, Huber K, Komara K, Letendre S, Baker S, et al. A Test of Vehicle-to-Grid  
18 (V2G) for Energy Storage and Frequency Regulation in the PJM System. 2008.  
19  
20 [307] Ekman CK. On the synergy between large electric vehicle fleet and high wind penetration – An  
21 analysis of the Danish case. *Renew Energy* 2011;36:546–53.  
22  
23 [308] Wang J, Liu C, Ton D, Zhou Y, Kim J, Vyas A. Impact of plug-in hybrid electric vehicles on  
24 power systems with demand response and wind power. *Energy Policy* 2011;39:4016–21.  
25  
26 [309] Kiviluoma J, Meibom P. Coping with Wind Power Variability: How Plug-in Electric Vehicles  
27 Could Help. 8th Int. Work. Large-Scale Integr. Wind Power into Power Syst. as well as Transm.  
28 Networks, 2009.  
29  
30 [310] KEMA, ISO/RTO Council. Assessment of Plug-in Electric Vehicle Integration with ISO/RTO  
31 Systems. 2010.  
32  
33 [311] Peterson SB, Apt J, Whitacre JF. Lithium-ion battery cell degradation resulting from realistic  
34 vehicle and vehicle-to-grid utilization. *J Power Sources* 2010;195:2385–92.  
35  
36 [312] Peterson SB, Whitacre JF, Apt J. The economics of using plug-in hybrid electric vehicle battery  
37 packs for grid storage. *J Power Sources* 2010;195:2377–84.  
38  
39 [313] Pillai JR, Bak-Jensen B. Impacts of electric vehicle loads on power distribution systems. 2010  
40 IEEE Veh. Power Propuls. Conf., IEEE; 2010, p. 1–6.  
41  
42 [314] Peças Lopes JA, Soares FJ, Rocha Almeida PM, Lopes JAP, Almeida PMR. Integration of electric  
43 vehicles in the electric power system. *Proc IEEE* 2011;99:168–83.  
44  
45 [315] Kempton W, Tomić J. Vehicle-to-grid power implementation: From stabilizing the grid to  
46 supporting large-scale renewable energy. *J Power Sources* 2005;144:280–94.  
47  
48 [316] Kaewpuang R, Niyato D. An energy efficient solution: Integrating Plug-In Hybrid Electric Vehicle  
49 in smart grid with renewable energy. 2012 Proc. IEEE INFOCOM Work., 2012, p. 73–8.  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [317] Yoshimi K, Osawa M, Yamashita D, Niimura T, Yokoyama R, Masuda T, et al. Practical storage  
5 and utilization of household photovoltaic energy by electric vehicle battery. 2012 IEEE PES  
6 Innov. Smart Grid Technol., 2012, p. 1–8.  
7  
8  
9 [318] Smith JC, Osborn D, Zavadil R, Lasher W, Gómez-Lázaro E, Estanqueiro A, et al. Transmission  
10 planning for wind energy in the United States and Europe: status and prospects. Wiley Interdiscip  
11 Rev Energy Environ 2013;2:1–13.  
12  
13 [319] Van Hertem D, Ghandhari M. Multi-terminal VSC HVDC for the European supergrid: Obstacles.  
14 Renew Sustain Energy Rev 2010;14:3156–63.  
15  
16 [320] Van Hertem D, Ghandhari M, Delimar M. Technical Limitations towards a SuperGrid – A  
17 European Prospective. 2010 IEEE Int. Energy Conf. Exhib., Manama: 2010, p. 302–9.  
18  
19 [321] Macilwain C. Supergrid. Nature 2010;468:624–5.  
20  
21 [322] Feltes JW, Gemmel BD, Retzmann D. From Smart Grid to Super Grid : Solutions with HVDC  
22 and FACTS for Grid Access of Renewable Energy Sources. Power Energy Soc. Gen. Meet., 2011,  
23 p. 1–6.  
24  
25 [323] Zhang X-P, Yao L. A Vision of Electricity Network Congestion Management with FACTS and  
26 HVDC. Third Int. Conf. Electr. Util. Deregul. Restruct. Power Technol., 2008, p. 116–21.  
27  
28 [324] Coll-Mayor D, Schmid J. Opportunities and barriers of high-voltage direct current grids: a state of  
29 the art analysis. Wiley Interdiscip Rev Energy Environ 2012;1:233–42.  
30  
31 [325] Vrana TK, Torres-Olguin RE, Liu B, Haileselassie TM. The North Sea super grid - a technical  
32 perspective. 9th IET Int. Conf. AC DC Power Transm., 2010, p. 1–5.  
33  
34 [326] Farahmand H, Huertas-Hernando D, Warland L, Korpas M, Svendsen HG. Impact of system  
35 power losses on the value of an offshore grid for North Sea offshore wind. 2011 IEEE Trondheim  
36 PowerTech, 2011, p. 1–7.  
37  
38 [327] Trieb F, Müller-Steinhagen H. The Desertec concept – Sustainable electricity and water for  
39 Europe, Middle East and North Africa. Whiteb TREC Club Rome-Clean Power from Deserts  
40 2007:23–43.  
41  
42 [328] Lilliestam J, Ellenbeck S. Energy security and renewable electricity trade—Will Desertec make  
43 Europe vulnerable to the “energy weapon”? Energy Policy 2011;39:3380–91.  
44  
45 [329] Farhangi H. The path of the smart grid. IEEE Power Energy Mag 2010;8:18–28.  
46  
47 [330] Ipakchi A, Albuyeh F. Grid of the future. IEEE Power Energy Mag 2009;7:52–62.  
48  
49 [331] Pilo F, Celli G, Ghiani E, Soma GG. New electricity distribution network planning approaches for  
50 integrating renewable. Wiley Interdiscip Rev Energy Environ 2013;2:140–57.  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65

- 1  
2  
3  
4 [332] Hledik R. How green is the smart grid? *Electr J* 2009;22:29–41.  
5  
6 [333] Brown RE. Impact of Smart Grid on distribution system design. 2008 IEEE Power Energy Soc.  
7 Gen. Meet. - Convers. Deliv. Electr. Energy 21st Century, IEEE; 2008, p. 1–4.  
8  
9 [334] Harris A. Smart grid thinking. *Eng Technol* 2009:46–9.  
10  
11 [335] Potter CW, Archambault A, Westrick K. Building a smarter smart grid through better renewable  
12 energy information. 2009 IEEE/PES Power Syst. Conf. Expo., IEEE; 2009, p. 1–5.  
13  
14 [336] Battaglini A, Lilliestam J, Haas A, Patt A. Development of SuperSmart Grids for a more efficient  
15 utilisation of electricity from renewable sources. *J Clean Prod* 2009;17:911–8.  
16  
17 [337] Brown MA, Zhou S. Smart-grid policies: an international review. *Wiley Interdiscip Rev Energy*  
18 *Environ* 2013;2:121–39.  
19  
20 [338] Watson S. Quantifying the variability of wind energy. *Wiley Interdiscip Rev Energy Environ*  
21 *2014;3:330–42.*  
22  
23 [339] Bessa R, Moreira C, Silva B, Matos M. Handling renewable energy variability and uncertainty in  
24 power systems operation. *Wiley Interdiscip Rev Energy Environ* 2014;3:156–78.  
25  
26 [340] Voronin S, Partanen J. Forecasting electricity price and demand using a hybrid approach based on  
27 wavelet transform, ARIMA and neural networks. *Int J Energy Res* 2014;38:626–37.  
28  
29 [341] Sousa JC, Jorge HM, Neves LP. Short-term load forecasting based on support vector regression  
30 and load profiling. *Int J Energy Res* 2014;38:350–62.  
31  
32 [342] Mohd A, Ortjohann E, Schmelter A, Hamsic N, Morton D. Challenges in Integrating Distributed  
33 Energy Storage Systems into Future Smart Grid. *IEEE Int. Symp. Ind. Electron.*, 2008, p. 1627–  
34 32.  
35  
36 [343] Güngör VC, Sahin D, Kocak T, Ergüt S, Buccella C, Cecati C, et al. Smart Grid Technologies :  
37 Communication Technologies and Standards. *IEEE Trans Ind Informatics* 2011;7:529–39.  
38  
39 [344] Sood VK, Fischer D, Member S, Eklund JM, Brown T. Developing a Communication  
40 Infrastructure for the Smart Grid. 2009 IEEE Electr. Power Energy Conf., vol. 4, Montreal, QC:  
41 2009, p. 1–7.  
42  
43 [345] Fadlullah Z, Fouda MM, Kato N, Takeuchi A, Iwasaki N, Nozaki Y. Toward Intelligent Machine-  
44 to-Machine Communications in Smart Grid. *IEEE Commun Mag* 2011;11:60–5.  
45  
46 [346] Li F, Qiao W, Sun H, Wan H, Wang J, Xia Y, et al. Smart Transmission Grid: Vision and  
47 Framework. *IEEE Trans Smart Grid* 2010;1:168–77.  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65


- 1  
2  
3  
4 [347] Lasseter RH. MicroGrids. 2002 IEEE Power Eng. Soc. Winter Meet. Conf. Proc. (Cat.  
5 No.02CH37309), vol. 1, IEEE; 2002, p. 305–8.  
6  
7  
8 [348] Lasseter RH, Paigi P. Microgrid: a conceptual solution. 2004 IEEE 35th Annu. Power Electron.  
9 Spec. Conf. (IEEE Cat. No.04CH37551), IEEE; 2004, p. 4285–90.  
10  
11 [349] Lopes JAP, Madureira AG, Moreira CCLM. A view of microgrids. Wiley Interdiscip Rev Energy  
12 Environ 2013;2:86–103.  
13  
14 [350] Xuan Liu, Bin Su. Microgrids — an integration of renewable energy technologies. 2008 China Int.  
15 Conf. Electr. Distrib., IEEE; 2008, p. 1–7.  
16  
17  
18 [351] Barnes M, Kondoh J, Asano H, Oyarzabal J, Ventakaramanan G, Lasseter R, et al. Real-World  
19 MicroGrids-An Overview. 2007 IEEE Int. Conf. Syst. Syst. Eng., IEEE; 2007, p. 1–8.  
20  
21 [352] Beyer HG, Luther J, Steinberger-Willms R. Power fluctuations in spatially dispersed wind turbine  
22 systems. Sol Energy 1993;50:297–305.  
23  
24  
25 [353] Rosas P. Dynamic influences of wind power on the power system. DTU Technical University of  
26 Denmark, 2003.  
27  
28 [354] Nanahara T, Asari M, Sato T, Yamaguchi K, Shibata M, Maejima T. Smoothing effects of  
29 distributed wind turbines. Part 1. Coherence and smoothing effects at a wind farm. Wind Energy  
30 2004;7:61–74.  
31  
32  
33 [355] Nanahara T, Asari M, Maejima T, Sato T, Yamaguchi K, Shibata M. Smoothing effects of  
34 distributed wind turbines. Part 2. Coherence among power output of distant wind turbines. Wind  
35 Energy 2004;7:75–85.  
36  
37  
38 [356] Holttinen H, Meibom P, Orths A, van Hulle F, Lange B, O’Malley M, et al. Design and operation  
39 of power systems with large amounts of wind power. 2009.  
40  
41 [357] Sørensen P, Cutululis NA, Viguera-Rodríguez A, Jensen LE, Hjerrild J, Donovan MH, et al.  
42 Power Fluctuations From Large Wind Farms. IEEE Trans Power Syst 2007;22:958–65.  
43  
44  
45 [358] Holttinen H. Hourly wind power variations in the Nordic countries. Wind Energy 2005;8:173–95.  
46  
47 [359] Drake B, Hubacek K. What to expect from a greater geographic dispersion of wind farms?—A  
48 risk portfolio approach. Energy Policy 2007;35:3999–4008.  
49  
50 [360] Roques F, Hiroux C, Sagan M. Optimal wind power deployment in Europe—A portfolio  
51 approach. Energy Policy 2010;38:3245–56.  
52  
53  
54 [361] Mills A, Wisner R. Implications of Wide-Area Geographic Diversity for Short-Term Variability of  
55 Solar Power. Lawrence Berkeley National Laboratory Paper LBNL-3884E. 2010.  
56  
57

- 1  
2  
3  
4 [362] Lave M, Kleissl J. Solar variability of four sites across the state of Colorado. *Renew Energy* 2010;35:2867–73.  
5  
6  
7  
8 [363] Tarroja B, Mueller F, Samuelsen S. Solar power variability and spatial diversification:  
9 implications from an electric grid load balancing perspective. *Int J Energy Res* 2013;37:1002–16.  
10  
11 [364] Nicolosi M. Wind power integration and power system flexibility—An empirical analysis of  
12 extreme events in Germany under the new negative price regime. *Energy Policy* 2010;38:7257–68.  
13  
14 [365] Nicolosi M, Fürsch M. The Impact of an increasing share of RES-E on the Conventional Power  
15 Market — The Example of Germany. *Zeitschrift Für Energiewirtschaft* 2009;33:246–54.  
16  
17 [366] European Commission. Energy prices and costs report. SWD(2014) 20 final/2. 2014.  
18  
19 [367] Weber C. Adequate intraday market design to enable the integration of wind energy into the  
20 European power systems. *Energy Policy* 2010;38:3155–63.  
21  
22 [368] Winkler J, Altmann M. Market Designs for a Completely Renewable Power Sector. *Zeitschrift Für*  
23 *Energiewirtschaft* 2012;36:77–92.  
24  
25 [369] Holttinen H. Optimal electricity market for wind power. *Energy Policy* 2005;33:2052–63.  
26  
27 [370] Lorenz E, Scheidsteger T, Hurka J, Heinemann D, Kurz C. Regional PV power prediction for  
28 improved grid integration. *Prog Photovoltaics Res Appl* 2011;19:757–71.  
29  
30 [371] Kiviluoma J, Meibom P, Tuohy A. Short-term energy balancing with increasing levels of wind  
31 energy. *IEEE Trans Sustain Energy* 2012;3:769–76.  
32  
33 [372] Scharff R, Amelin M, Söder L. Approaching wind power forecast deviations with internal ex-ante  
34 self-balancing. *Energy* 2013;57:106–15.  
35  
36 [373] Henriot A, Glachant J-M. Melting-pots and salad bowls: The current debate on electricity market  
37 design for integration of intermittent RES. *Util Policy* 2013;27:57–64.  
38  
39 [374] Ueckerdt F, Hirth L, Luderer G, Edenhofer O. System LCOE: What are the costs of variable  
40 renewables? *Energy* 2013;63:61–75.  
41  
42 [375] Obersteiner C. The Influence of interconnection capacity on the market value of wind power.  
43 *Wiley Interdiscip Rev Energy Environ* 2012;1:225–32.  
44  
45 [376] European Commission. Single market for gas & electricity.  
46 [http://ec.europa.eu/energy/gas\\_electricity/internal\\_market\\_en.htm](http://ec.europa.eu/energy/gas_electricity/internal_market_en.htm) Accessed: 12/5/14  
47  
48 [377] Gawel E, Purkus A. Promoting the market and system integration of renewable energies through  
49 premium schemes—A case study of the German market premium. *Energy Policy* 2013;61:599–  
50 609.  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65




- 1  
2  
3  
4 [378] Hiroux C, Saguan M. Large-scale wind power in European electricity markets: Time for revisiting  
5 support schemes and market designs? *Energy Policy* 2010;38:3135–45.  
6  
7  
8 [379] Vandezande L, Meeus L, Belmans R, Saguan M, Glachant J-M. Well-functioning balancing  
9 markets: A prerequisite for wind power integration. *Energy Policy* 2010;38:3146–54.  
10  
11 [380] Hobbs BF, Inon JG, Stoft SE. Capacity markets: review and a dynamic assessment of demand-  
12 curve approaches. *IEEE Power Eng Soc Gen Meet* 2005:2792–800.  
13  
14  
15 [381] Energy storage: What do we need to do to make it happen? *Energy Storage J* 2014:1.  
16  
17 [382] European Association for Storage of Electricity. Activity Report 2011-2012. Brussels, Belgium:  
18 2012.  
19  
20 [383] Darby M. Electricity storage: the poor cousin of the energy family. *Util Week* 2014:1.  
21  
22  
23 [384] The Electricity Storage Network. Electricity Energy Storage in the United Kingdom: Time for  
24 Action: A briefing note from the Electricity Storage Network 2013:1–2.  
25  
26 [385] Su C-L, Kirschen D. Quantifying the Effect of Demand Response on Electricity Markets. *IEEE*  
27 *Trans Power Syst* 2009;24:1199–207.  
28  
29  
30 [386] Roozbehani M, Dahleh M, Mitter S. Volatility of power grids under real-time pricing. *IEEE Trans*  
31 *Power Syst* 2011;27:1926–40.  
32  
33 [387] International Energy Agency. Energy Technology Perspectives 2014 - Harnessing Electricity's  
34 Potential. 2014.  
35  
36 [388] International Energy Agency. Renewable Energy Medium-Term market Report 2013. 2013.  
37  
38 [389] International Energy Agency. Renewable Energy Medium-Term Market Report 2014. 2014.  
39  
40 [390] International Energy Agency. Deploying Renewables: Best and Future Policy Practices. 2012.  
41  
42 [391] International Energy Agency. World Energy Outlook 2013. 2013.  
43  
44 [392] Electricity Storage Association. Technology Comparisons 2011. 2011.  
45  
46 [393] Electric Power Research Institute. Electricity Energy Storage Technology Options: A White Paper  
47 Primer on Applications, Costs, and Benefits. 2010.  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65


Figure 1

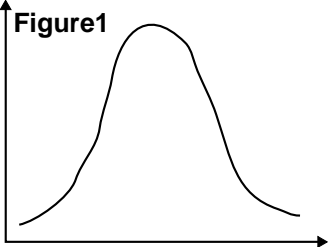


Flexible load shape

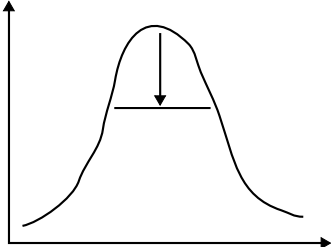


Peak shaving

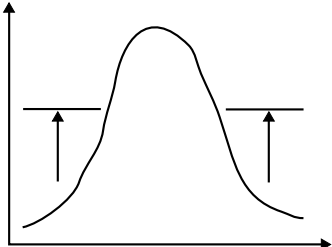


Valley filling

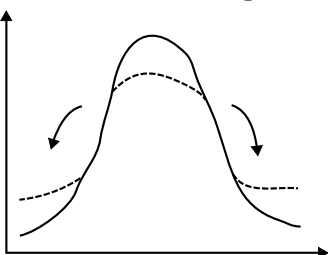

Load shifting

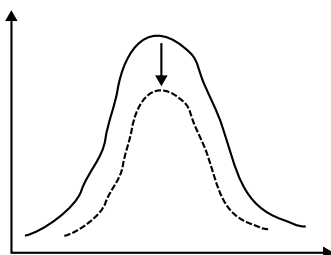

Conservation

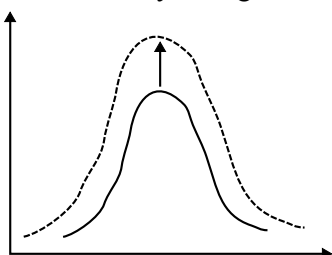

Load growth

Figure 20 GW

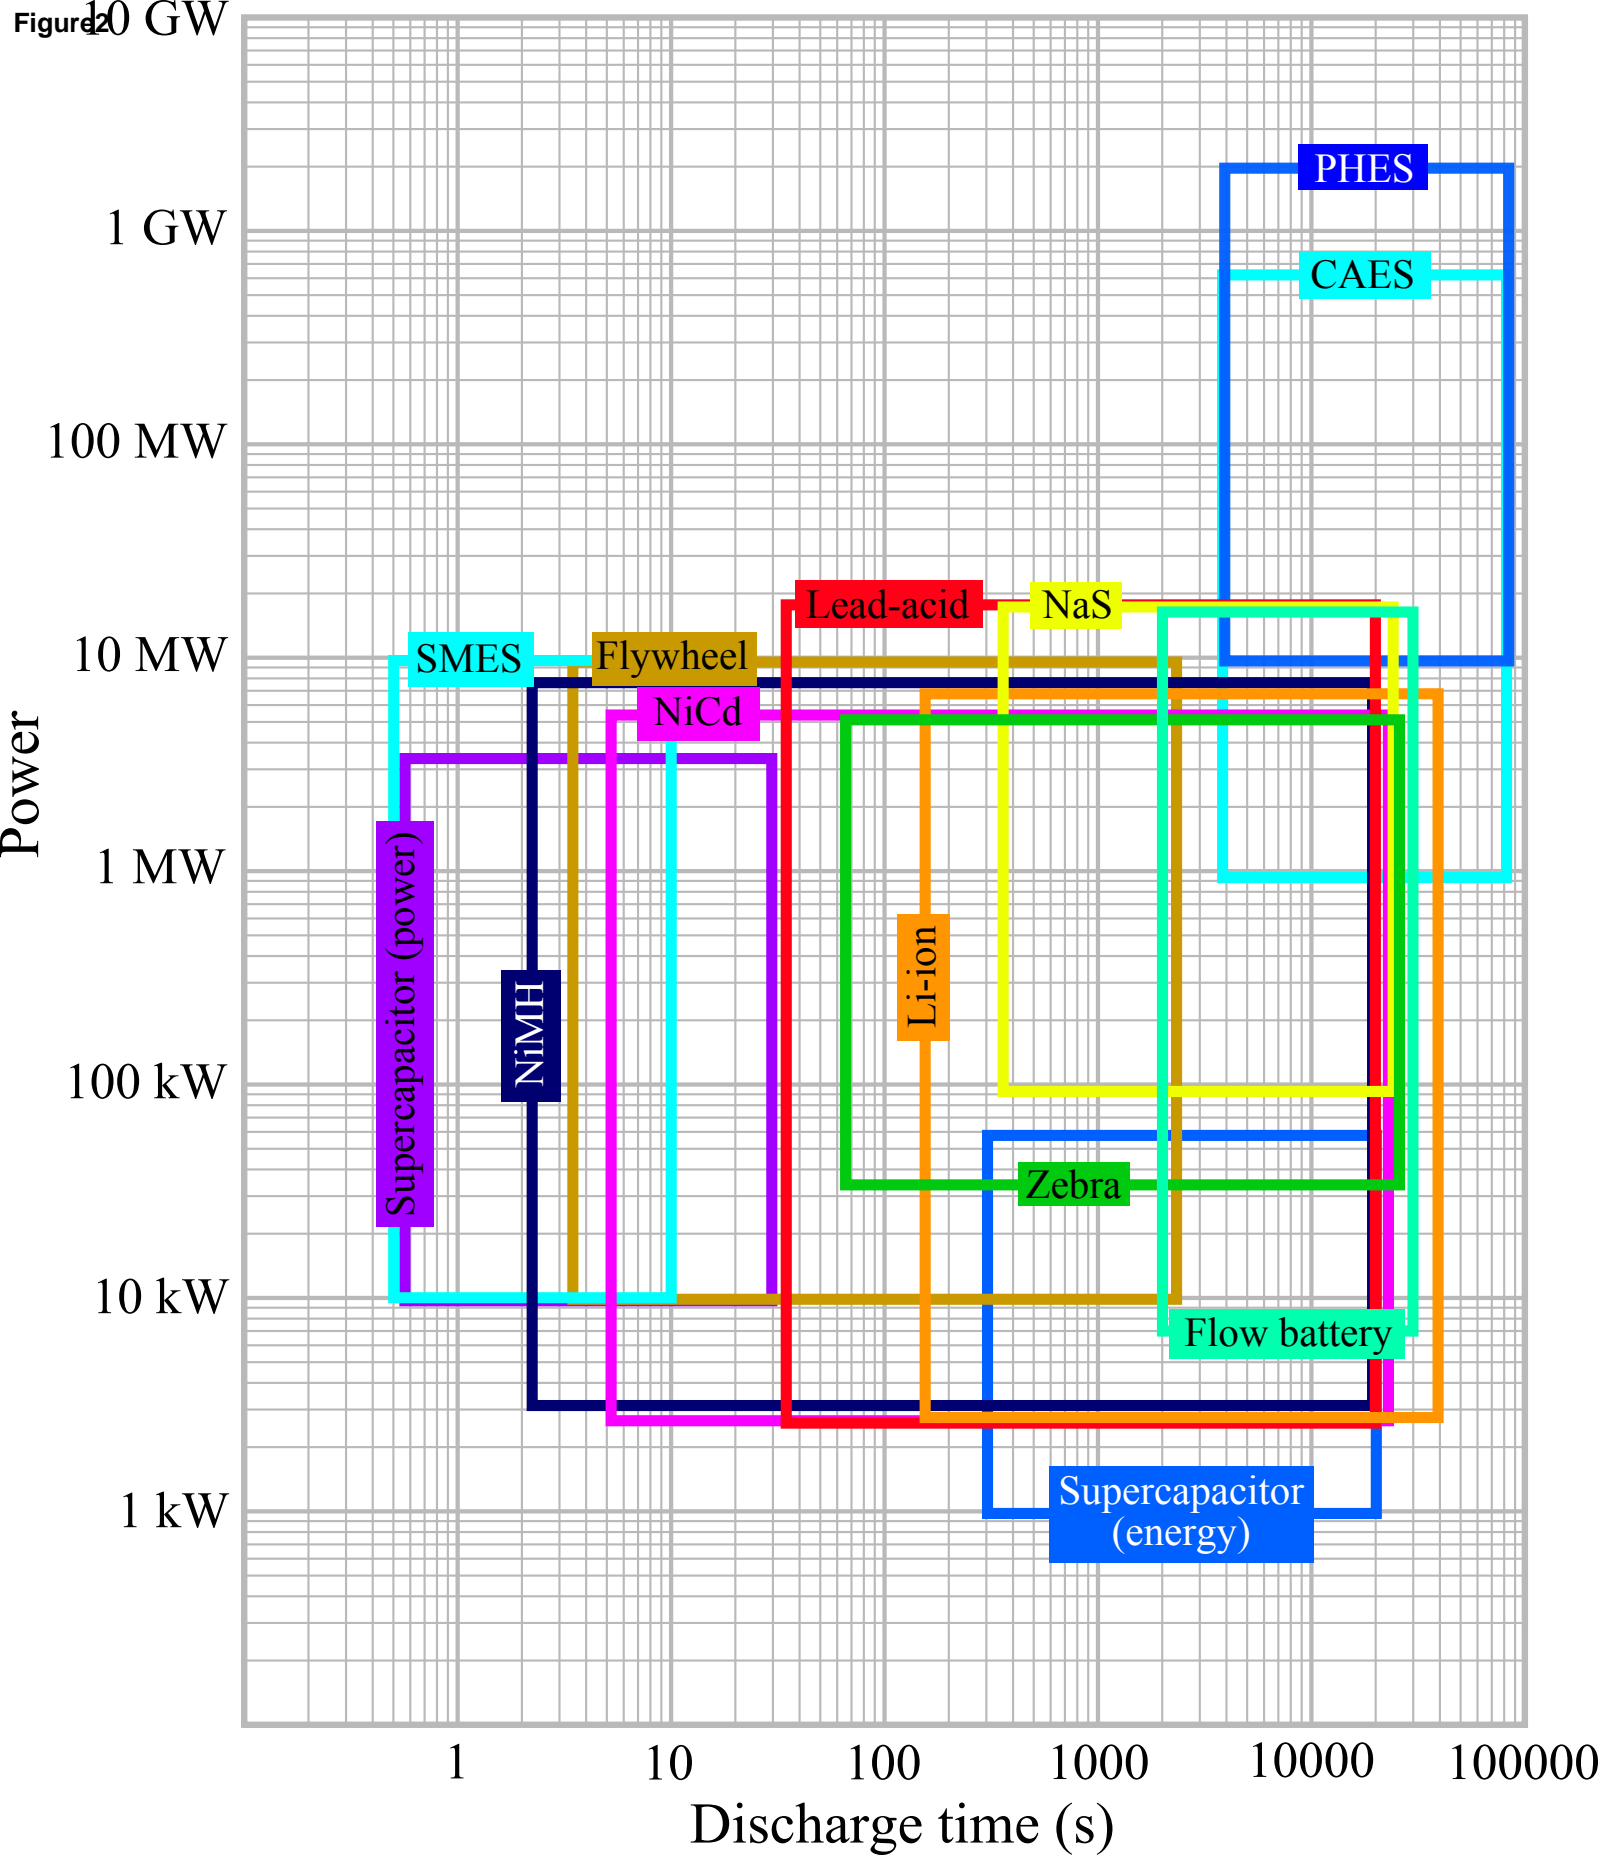


Figure3

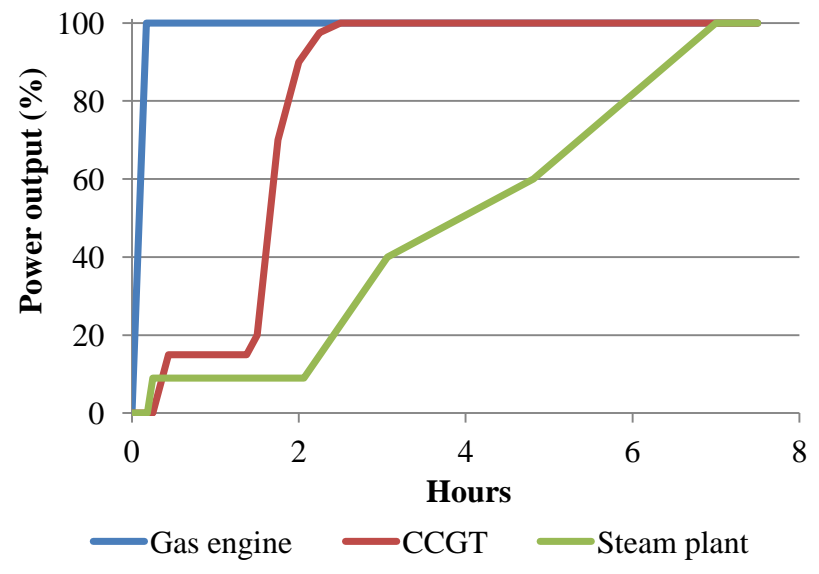


Figure4

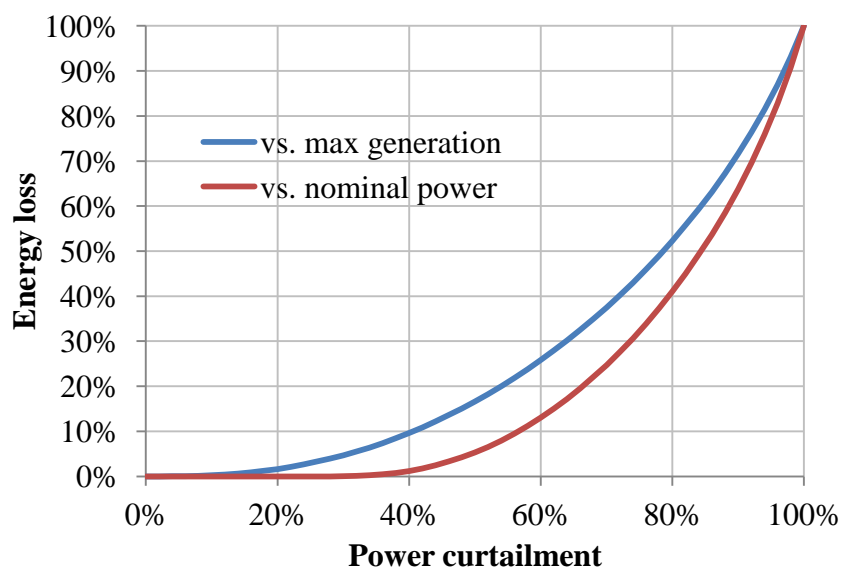


Table 1. DSM potential of residential loads in Germany [32,51,63,64].

Load	Positive capacity	Negative capacity	Storage from load shifting	Investment costs	Variable costs	Fixed costs
Night storage heaters	19–88%	128%	58%	10%	~0%	11%
Domestic hot water heaters	1–5%	17%	90%	113%	~0%	11%
Ventilation systems	8–38%	55%	8%	N.A.	N.A.	N.A.
Refrigerators	2–9%	15%	90% with freezers	298%	~0%	228%
Freezers	9–19%	12%	90% with refrigerators	298%	~0%	228%
Hot water circulation pumps	3–14%	None	98%	1625%	~0%	250%
Washing machines, dryers and dishwashers	5–24%	72%	105%	185%	~0%	183%
Heat pumps with storage	0.3–1%	0.7%	8%	38%	N.A.	N.A.

Table 1. DSM potential of service sector loads in Germany [32,64].

Load	Positive capacity	Negative capacity	Investment costs	Variable costs	Fixed costs
Food store refrigerators	1–7%	10%	0.8–222%	1%	~0%
Electric hot water generation	0.1–0.7%	3%	7–45%	1%	~0%
Ventilation systems	0.6–3%	5%	87–307%	1%	~0%
Air conditioning	0.6–3%	8%	4–148%	1%	~0%
Night storage heaters	1–5%	33%	2–12%	1%	~0%
Municipal waste water treatment	0.2–0.8%	None	4–187%	1%	39–231%

Table 1. DSM potential of industrial loads in Germany [32,33,63].

Load	Positive capacity	Negative capacity	Storage from load shifting	Investment costs	Variable costs	Fixed costs
Chloralkali electrolysis	0.8–4%	Small	3%	< 0.3%	> 147%	~0%
Mechanical wood pulp refining	0.3–2%	0.1–0.4%	1%	3–4%	< 15%	~0%
Aluminum electrolysis	0.4–2%	None	None	< 0.3%	740–2206%	~0%
Cement milling	0.3–2%	0.1–0.4%	8%	4–5%	588–1471%	~0%
Steel melting in electric arc furnaces	1–7%	None	None	< 0.3%	> 2941%	~0%
Compressed air with variable speed compressors	0.3–1%	0.1–0.6%	40%	6%	N.A.	N.A.
Ventilation systems	1–7%	0.2–0.9%	N.A.	97%	N.A.	~0%
Cooling and freezing in food industry	2–9%	0.9–4%	N.A.	N.A.	N.A.	~0%
Process cooling in chemical industry	0.8–4%	None	None	N.A.	N.A.	~0%



Table 4. Grid ancillary services categorized based on service duration [136,137].

Duration	Services	Examples of technologies
Very short 1 ms – 5 min	Power quality, regulation	Flywheels, DSM
Short 5 min – 1 h	Spinning reserve, contingency reserve, black start	Flow batteries, PHES, DSM
Intermediate 1 h – 3 d	Load following, load leveling/peak shaving/valley filling, transmission curtailment prevention, transmission loss reduction, unit commitment	CAES, PHES, DSM
Long months	Seasonal shifting	CAES, PHES

Table 5. Key parameters of selected secondary battery chemistries.

Chemistry	Efficiency (%)	Specific energy (Wh/kg)	Energy density (Wh/l)	Specific power (W/kg)	Cycle life (cycles @ DOD), NR=DOD not reported	References
Lead-acid (PbA)	75-85	20-40	55-90	75-415	250-2000 @ 60% 200-800 @ 80% 300-1000 @ NR	[171,174,216,223,224,229-236]
Nickel-cadmium (NiCd)	60-75	40-65	60-150	100-175	5000 @ 60% 1000-2000 @ 80% 2000-2500 @ NR	[141,171,223,224,229-231,233,235,236]
Nickel-metal hydride (NiMH)	64-66	45-80	140-300	200-1500	300-1200 @ 80% 200-1500 @ NR	[141,223,224,229-231,233,236,237]
Sodium-sulphur (NaS)	75-85	100-200	150-250	150-250	1000-5000 @ 80% 1000-5000 @ NR	[141,146,174,223,224,231,232,236,238]
Sodium nickel-chlorine (Zebra)	90-100	85-140	150-175	150-250	1500-3500 @ 80% 1000-3000 @ NR	[141,223,224,231,239-243]
Lithium-ion (Li-ion)	90-100	90-190	250-500	500-2000	500-7000 @ 80%	[141,216,223,224,229-231,234]

Table 6. Performance indicators of power plants at full output (average indicative values from literature; individual projects can considerably deviate from these). [68]

Indicator	Hard coal	Lignite	Nuclear	CCGT > 300 MW	Simple-cycle gas engine > 5 MW
Investment (US\$/kW)	1900	2200	3900	1000	650
Net fuel efficiency (%)	40	36	33	55	47
Fuel price (US\$/GJ)	5	4	1,5	6,5	6,5
Operation and maintenance costs (US\$/MWh)	13	16	13	13	13
Specific CO <sub>2</sub> emission (g/kWh)	820	1030	–	370	450
Lead time to commissioning (months)	40	45	60	24	12
Start-up and synchronize time (min)	300	300	300	5	1
Ramp-up rate (%/min)	3	2	2	3–5	20